



Shri Shivaji Education Society Amravati's
DR. PANJABRAO ALIAS BHAUSAHEB DESHMUKH
MEMORIAL MEDICAL COLLEGE
Shivaji Nagar, Amravati- 444603



Dr. Anil T. Deshmukh
MD (Pathology)
Dean



Shri. Harshvardhan P. Deshmukh
President
Shri Shivaji Education Society

•OfficeTel: 0721-2552353 •Fax: 0721-2552353 •Website: www.pdmmc.edu.in •E-mail: drpdmmc2007@rediffmail.com


Logbook or other records regarding maintenance work

INDEX

Sr.No.	Content
1.	Preventive & Corrective Maintenance of life support Equipments
A	Flow Chart
B	AMC/CMC
C	Calibration of Instruments
D	Medical Gas & Vacuum Maintenance
2.	Maintenance Of Potable Water Supply
3.	Electrical Maintenance



Flow Sheet Diagram of Repair & Maintenance of Biomedical Instruments

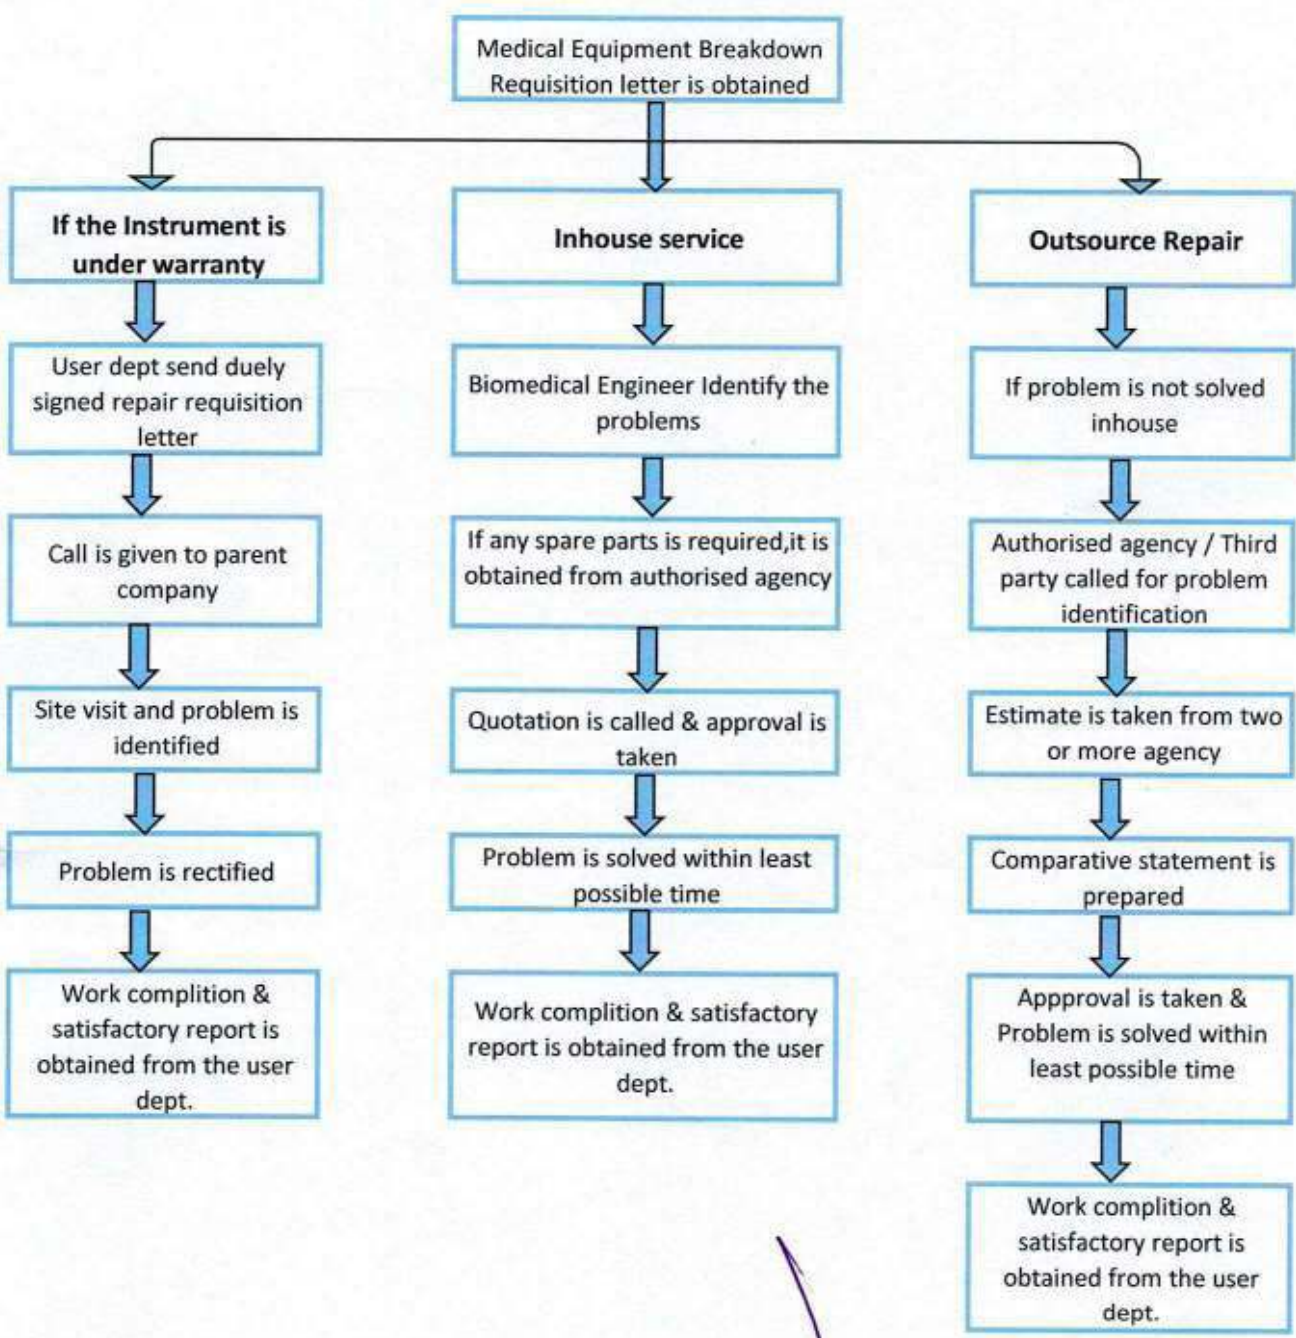

For

[Handwritten signature]



Dr. Anil T. Deshmukh
M.D. (Pathology)
DEAN

SHRI SHIVAJI EDUCATION SOCIETY, AMRAVATI'S
Dr. Panjabrao Alias Bhausaheb Deshmukh
Memorial Medical College
Shivaji Nagar, Amravati - 444 603



Harshvardhan P. Deshmukh
PRESIDENT



• Office: Tel. (0721) 2552353 • Fax.: (0721) 2552353 • E-mail: drpdnmc2007@rediffmail.com, drpdnmcamravati@gmail.com • Website: http://pdnmc.edu.in

Summery

AMC & CMC

No. of instruments under AMC – 593

No. of instruments under CMC – 43

The list with duration of AMC & CMC Attached

I/C Repair Section
Dr. P.D.M.M.C. Amravati

Chairperson - Criteria No. _
NAAC Steering Committee
Dr. P. D. M. M. C. Amravati



SHRI SHIVAJI EDUCATION SOCIETY, AMRAVATI'S
Dr. Panjabrao Alias Bhausaheb Deshmukh
Memorial Medical College
 Shivaji Nagar, Amravati - 444 603



Dr. Anil T. Deshmukh
 M.D. (Pathology)
 DEAN

Harshvardhan P. Deshmukh
 PRESIDENT



Office: Tel. (0721) 2552353 Fax.: (0721) 2552353 E-mail: drpdmmc2007@rediffmail.com, drpdmmcamravati@gmail.com Website: http://pdmmc.edu.in

AMC -CMC list 2023/2024

SR NO	USER DEPARTMENT & LOCATION	NAME OF EQUIPMENTS/ MAKE/ MODEL/ SERIAL NUMBER	TYPE OF CONTRACT	AMC/CMC CONTRACT PERIOD		AMC/CMC VALUE	Parent company recommended PMS/Year	SERVICE PROVIDERS (PARENT COMPANIES)
				From	To			
1	RADIOLOGY	C T SCAN (16 SLICE)/Wipro GE/083021205480418 (05 year contract)	CMC	10-08-2022	09-08-2027	1,33,37,868/-	3	Wipro GE Healthcare pvt ltd
2	RADIOLOGY	MRI (1.5 T)/Wipro GE/083049207263516	CMC	01-03-2023	28-02-2024	38,72,603/-	3	Wipro GE Healthcare pvt ltd
3	RADIOLOGY	GE/logic p9 / 083037202839518/USG MACHINE/	CMC	01-04-2023	31-03-2024	2,80,368/-	2	Wipro GE Healthcare pvt ltd
4	RADIOLOGY	AGFA/ CR SYSTEM/AGFA/DXM/17678	AMC	01-12-2022	30-11-2023	41300/-	2	AGFA HEALTHCARE PVT LTD , MUMBAI
5	RADIOLOGY	HITACHI ALOKA / F31/M00146LI/COLOUR DOPLER	AMC	01-12-2021	30/11/2022	47200/-	2	TRIVITRON HEALTHCARE PVT.LTD,Ngp
6	OT COM.02 CVTS	Anesthesia Workstation/GE/9100C/ME14090667	AMC	01-01-2023	31-12-2023	84,000/-	2	RISING TECTNOLOGY,NAGPUR
7	OT COM.01	Anesthesia Workstation/GE/9100C NXT/SPC18441001WA	AMC	01-01-2023	31-12-2023		2	RISING TECTNOLOGY,NAGPUR
8	OT COMPLEX NO.02	Anesthesia Workstation/GE/9100C/SPC19190564WA	AMC	01-01-2023	31-12-2023		2	RISING TECTNOLOGY,NAGPUR
9	MICU	PHOENIX VENTI/NUMO/1059	AMC	01-07-2022	30/06/2023		4	V T SALES NAGPUR
10	MICU	PHOENIX VENTI/NUMO/1137	AMC	01-07-2022	30/06/2023		4	V T SALES NAGPUR
11	MICU	PHOENIX VENTI/NUMO/1054	AMC	01-07-2022	30/06/2023		4	V T SALES NAGPUR
12	GYNIC ICU	PHOENIX VENTI/NUMO/1385	AMC	01-07-2022	30/06/2023		4	V T SALES NAGPUR

13	CARDIAC ICU	PHOENIX VENTI/NUMO/1383	AMC	01-07-2022	30/06/2023	2,00,000/-	4	V T SALES NAGPUR
14	CARDIAC ICU	PHOENIX VENTI/NUMO/1407	AMC	01-07-2022	30/06/2023		4	V T SALES NAGPUR
15	CASUALTY	PHOENIX VENTI/NUMO/1019	AMC	01-07-2022	30/06/2023		4	V T SALES NAGPUR
16	SICU	PHOENIX VENTI/NUMO/1402	AMC	01-07-2022	30/06/2023		4	V T SALES NAGPUR
17	SICU	PHOENIX VENTI/NUMO/1408	AMC	01-07-2022	30/06/2023		4	V T SALES NAGPUR
18	IRCU	PHOENIX VENTI/NUMO/1404	AMC	01-07-2022	30/06/2023		4	V T SALES NAGPUR
19	CSSD	AUTOCLAVE MACHINE	CMC	01-10-2022	31-09-2023	60,000/-	2	V T SALES NAGPUR
20	ICCU	2D ECHO MC/PHILIPS/HD 11XE/US91370237	AMC	01-09-2022	30/08/2023	42,000/-	2	ATRIUM HEALTHCARE,Ngp
21	OPHTHAL OT	PHACO MACHINE/ALCON LAB/1301767201X	CMC	07-01-2022	30/06/2023	97,448/-	2	ALCON LABORATORIES
22	CARDIAC ICU	VENTILATOR/GE/Ivent201 versamed/IV33529	AMC	20-09-2022	19-09-2023	75,000/-	4	VELA HEALTHCARE SERVICES,Ngp
23	SICU	VENTILATOR/GE/Ivent201 versamed/IV4500	AMC	20-09-2022	19-09-2023		4	VELA HEALTHCARE SERVICES,Ngp
24	PICU	VENTILATOR/GE/Ivent201 versamed/IV36878	AMC	20-09-2022	19-09-2023		4	VELA HEALTHCARE SERVICES,Ngp
25	PICU	VENTILATOR/GE/SIARE4000/	AMC	01-09-2022	02-09-2023	90,000/-	2	V T SALES NAGPUR
26	PICU	VENTILATOR/GE/SLE2000/FL2-1275	AMC	01-09-2022	03-09-2023		2	V T SALES NAGPUR
27	PICU	VENTILATOR/GE/Engstrom Carestation/CBCT01622	AMC	01-09-2022	04-09-2023		2	V T SALES NAGPUR
28	CASUALTY	VENTILATOR/MAQUET/SERVO S/36824	AMC	01-02-2023	31-01-2024	40,754/-	2	GETTINGE MEDICAL INDIA PVT LTD.NGP
29	MICU	MONITOR/NASAN/PARAMOUNT/132	CMC	01-10-2022	30-09-2023		2	VINAYAK AGENCY,AMRAVATI
30	MICU	MONITOR/NASAN/PARAMOUNT/133	CMC	01-10-2022	30-09-2023		2	VINAYAK AGENCY,AMRAVATI
31	MICU	MONITOR/NASAN/PARAMOUNT/140	CMC	01-10-2022	30-09-2023		2	VINAYAK AGENCY,AMRAVATI
32	MICU	MONITOR/NASAN/PARAMOUNT/142	CMC	01-10-2022	30-09-2023		2	VINAYAK AGENCY,AMRAVATI
33	MICU	MONITOR/NASAN/PARAMOUNT/144	CMC	01-10-2022	30-09-2023		2	VINAYAK AGENCY,AMRAVATI
34	MICU	MONITOR/NASAN/PARAMOUNT/147	CMC	01-10-2022	30-09-2023		2	VINAYAK AGENCY,AMRAVATI
35	MICU	MONITOR/NASAN/PARAMOUNT/149	CMC	01-10-2022	30-09-2023		2	VINAYAK AGENCY,AMRAVATI
36	MICU	MONITOR/NASAN/PARAMOUNT/143	CMC	01-10-2022	30-09-2023		2	VINAYAK AGENCY,AMRAVATI
37	OT COMPLEX NO.02	MONITOR/NASAN/PARAMOUNT/NA	CMC	01-10-2022	30-09-2023		2	VINAYAK AGENCY,AMRAVATI
38	OT COMPLEX NO.02	MONITOR/NASAN/PARAMOUNT/NA	CMC	01-10-2022	30-09-2023		2	VINAYAK AGENCY,AMRAVATI
39	OT COMPLEX NO.01	MONITOR/NASAN/PARAMOUNT/NA	CMC	01-10-2022	30-09-2023		2	VINAYAK AGENCY,AMRAVATI

40	OT COMPLEX NO.01	MONITOR/NASAN/PARAMOUNT/NA	CMC	01-10-2022	30-09-2023
41	OT COMPLEX NO.01	MONITOR/NASAN/PARAMOUNT/NA	CMC	01-10-2022	30-09-2023
42	OT COMPLEX NO.01	MONITOR/NASAN/PARAMOUNT/NA	CMC	01-10-2022	30-09-2023
43	OT COMPLEX NO.01	MONITOR/NASAN/PARAMOUNT/NA	CMC	01-10-2022	30-09-2023
44	MICU	ECG MACHINE/BPL/CARDIART 108T DIGI/DUTB5D3250	CMC	01-10-2022	30-09-2023
45	MICU	ECG MACHINE/BPL/CARDIART 108T DIGI/CGML4B22304	CMC	01-10-2022	30-09-2023
46	PICU	ECG MACHINE/BPL/CARDIART 108T DIGI/CGML4B22287	CMC	01-10-2022	30-09-2023
47	SICU	ECG MACHINE/BPL/CARDIART 108T DIGI/CGMG9B8599	CMC	01-10-2022	30-09-2023
48	CARDIAC ICU	ECG MACHINE/BPL/CARDIART 108T DIGI/CGML6B28535	CMC	01-10-2022	30-09-2023
49	GYNIC ICU	ECG MACHINE/BPL/CARDIART 108T DIGI/CGMG9BC8783	CMC	01-10-2022	30-09-2023
50	CASUALTY	ECG MACHINE/BPL/CARDIART 108T DIGI/NA	CMC	01-10-2022	30-09-2023
51	CASUALTY	ECG MACHINE/BPL/CARDIART 108T DIGI/CGML3L21844	CMC	01-10-2022	30-09-2023
52	M. SURGE.WRD 18/19	ECG MACHINE/BPL/CARDIART 108T DIGI/CGMG9C8778	CMC	01-10-2022	30-09-2023
53	MALE MED.WRD. 03	ECG MACHINE/BPL/CARDIART 108T DIGI/CGMG847309	CMC	01-10-2022	30-09-2023
54	MALE MED.WRD. 04	ECG MACHINE/BPL/CARDIART 108T DIGI/CGML4B22306	CMC	01-10-2022	30-09-2023
55	F. MED.WRD 16/17	ECG MACHINE/BPL/CARDIART 108T DIGI/CGMG9C8775	CMC	01-10-2022	30-09-2023
56	WARD NO.01	ECG MACHINE/BPL/CARDIART 108T DIGI/NA	CMC	01-10-2022	30-09-2023
57	WARD NO.02	ECG MACHINE/BPL/CARDIART 108T DIGI/NA	CMC	01-10-2022	30-09-2023
58	WARD NO.05	ECG MACHINE/BPL/CARDIART 108T DIGI/NA	CMC	01-10-2022	30-09-2023

4,21,750/-

2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI
2	VINAYAK AGENCY,AMRAVATI



Dr. Anil T. Deshmukh
M.D. (Pathology)
DEAN

SHRI SHIVAJI EDUCATION SOCIETY, AMRAVATI'S
Dr. Panjabrao Alias Bhausahab Deshmukh
Memorial Medical College
Shivaji Nagar, Amravati - 444 603



Harshvardhan P. Deshmukh
PRESIDENT



● Office: Tel. (0721) 2552353 ● Fax.: (0721) 2552353 ● E-mail: drpdmmc2007@rediffmail.com, drpdmmc@amravati@gmail.com ● Website: http://pdmmc.edu.in

Summary

Calibration of Instruments

Total No. of instruments calibrated are :- 1675

Approved Agency :- Autocall System , Pimpri ,Pune

List of Instruments are attached

I/C Repair Section
Dr. P.D.M.M.C. Amravati

Chairperson - Criteria No. _
NAAC Steering Committee
Dr. P. D. M. M. C. Amravati



National Accreditation Board for
Testing and Calibration Laboratories

CERTIFICATE OF ACCREDITATION

AUTOCAL SYSTEMS

has been assessed and accredited in accordance with the standard

ISO/IEC 17025:2017

**"General Requirements for the Competence of Testing &
Calibration Laboratories"**

for its facilities at

83/526, SANT TUKARAM NAGAR, PIMPRI, PUNE, MAHARASHTRA, INDIA

in the field of

TESTING

Certificate Number: TC-11417

Issue Date: 05/03/2023

Valid Until:

04/03/2025

This certificate remains valid for the Scope of Accreditation as specified in the annexure subject to continued satisfactory compliance to the above standard & the relevant requirements of NABL.

(To see the scope of accreditation of this laboratory, you may also visit NABL website www.nabl-india.org)

Name of Legal Identity : AUTOCAL SYSTEMS

Signed for and on behalf of NABL



N. Venkateswaran
Chief Executive Officer



SHRI SHIVAJI EDUCATION SOCIETY, AMRAVATI'S
**Dr. Panjabrao Alias Bhausaheb Deshmukh
Memorial Medical College**
Shivaji Nagar, Amravati - 444 603



Dr. Anil T. Deshmukh
M.D. (Pathology)
DEAN

Harshvardhan P. Deshmukh
PRESIDENT



● Office: Tel. (0721) 2552353 ● Fax: (0721) 2552353 ● E-mail: drpdmmc2007@rediffmail.com, drpdmmcamravati@gmail.com ● Website: http://pdmmc.edu.in

**Translated Document
(Certified by Head of Institute)
For NAAC Purpose**

Translation

Subject: - Regarding sanction of payment of Rs. 5,82,507/- (including all taxes) to M/s Autocal Ssystem, Pune, for calibration of Medical Equipment.

As per above mentioned subject calibration of medical equipment in hospital and college is necessary for NMC and NABH inspection. Therefore, calibration of Medical Equipment in Hospital and College has been done urgently from Autocal System Pune.

Said work is as per approval of this office dated 30/11/2019, has been done (above agreement in for 03 years).

01. Autocal system Pune
02. Invoice No. ACSM/22-23/122 dated 01/09/2022 Rs. 5,82,507/-

Submitted for year approval and sanction Rs. 5,82,507/- (five lakh eighty-two thousand five hundred seven).

Dean

Dr. P.D.M.M.C, Amravati

DEAN

Dr. Panjabrao Alias Bhausaheb Deshmukh
Memorial Medical College, Amravati



**Sd/ Illegible
(Original Signatory Authority)**

AUTOCAL SYSTEMS

83/526 Sant Tukaramnagar, Pimpri, Pune - 411018

Mob.- 9822136161, 7722092715

Email : autocalsystems@gmail.com, Website :

www.autocalsystems.com

CALIBRATION LAB

GSTIN : 27AINPB4245M1Z0 SAC CODE:998346

TAX INVOICE

INVOICE NO : ACSM/22-23/122

P. O NO :

INVOICE DATE : 01.09.2022

P. O . DATE :

Reverse Charge (Y/N) :

CHALLAN NO : N.A

STATE: MAHARASHTRA

CHALLAN DATE : N.A

Bill to Party

Ship to Party

NAME : Dr.PANJABRAO DESHMUKH HOSPITAL

NAME : Dr.PANJABRAO DESHMUKH HOSPITAL

ADDRESS : MORSHI ROAD ,SHIVAJI NAGAR,AMRAVATI -444603

ADDRESS : MORSHI ROAD ,SHIVAJI NAGAR,AMRAVATI -
444603

GSTIN : 27AAETS1500P2ZA

GSTIN : 27AAETS1500P2ZA

STATE : MAHARASHTRA

STATE : MAHARASHTRA

S. No.	Product Description	Qty	Rate	Amount	Disco unt	Taxable Value	CGST		SGST		Total
							Rate	Amount	Rate	Amount	
	CALIBRATION CHARGES FOR										
1	ABG ANALYZER MACHINE	1	450	450		450	9	40.50	9	40.50	531.00
2	ABG MACHINE	1	450	450		450	9	40.50	9	40.50	531.00
3	ANAESTHESIA MACHINE	2	450	900		900	9	81.00	9	81.00	1,062.00
4	ANESTHESIA MACHINE	8	450	3600		3600	9	324.00	9	324.00	4,248.00
5	AUTOCLAVE	10	800	8000		8000	9	720.00	9	720.00	9,440.00
6	AUTOCLAVE MACHINE	5	800	4000		4000	9	360.00	9	360.00	4,720.00
7	AUTOMATE RNA EXTRATION MACH	1	500	500		500	9	45.00	9	45.00	590.00
8	BABY WARMER	22	500	11000		11000	9	990.00	9	990.00	12,980.00
9	BABY WEIGHT MACHINE(ANALOG)	1	500	500		500	9	45.00	9	45.00	590.00
10	BABY WEIGHT MACHINE(DIGI)	1	500	500		500	9	45.00	9	45.00	590.00
11	BABY WEIGHT MACHINE(DIGITAL)	1	500	500		500	9	45.00	9	45.00	590.00
12	BASIC BOYLES	12	500	6000		6000	9	540.00	9	540.00	7,080.00
13	BIO SAFETY CABINET	2	4000	8000		8000	9	720.00	9	720.00	9,440.00
14	BIPAP MACHINE	24	500	12000		12000	9	1080.00	9	1080.00	14,160.00
15	BOD INCUBATOR	2	500	1000		1000	9	90.00	9	90.00	1,180.00
16	BP APPARATUS	80	200	16000		16000	9	1440.00	9	1440.00	18,880.00
17	BP APPARATUS(DIGI)	2	200	400		400	9	36.00	9	36.00	472.00
18	BP APPARATUS(DIGITAL)	1	200	200		200	9	18.00	9	18.00	236.00
19	CAMERA SYSTEM	1	500	500		500	9	45.00	9	45.00	590.00
20	CAUTERY MACHINE	12	500	6000		6000	9	540.00	9	540.00	7,080.00
21	CENTRIFUGE	19	400	7600		7600	9	684.00	9	684.00	8,968.00
22	CENTRIFUGE MACHINE	1	400	400		400	9	36.00	9	36.00	472.00
23	COOLING CENTRIFUGE	1	500	500		500	9	45.00	9	45.00	590.00
24	CYCLOMIXER	2	450	900		900	9	81.00	9	81.00	1,062.00
25	CYTOCENTRIFUGE	1	450	450		450	9	40.50	9	40.50	531.00
26	DEEFPREEZER	3	500	1500		1500	9	135.00	9	135.00	1,770.00
27	DEFIBRILATOR	4	450	1800		1800	9	162.00	9	162.00	2,124.00
28	DEFIBRILLATOR	17	450	7650		7650	9	688.50	9	688.50	9,027.00
29	DISCARDING AUTOCLAVE	1	800	800		800	9	72.00	9	72.00	944.00
30	DRILL MACHINE	5	500	2500		2500	9	225.00	9	225.00	2,950.00

35	BATH INCUBATOR	1	500	500	500	9	45.00	9	45.00	590.00
36	EG MACHINE	28	450	12600	12600	9	1134.00	9	1134.00	14,868.00
37	EG MACHINE	1	450	450	450	9	40.50	9	40.50	531.00
38	ELECTRICAL SUCTION MACHINE	1	600	600	600	9	54.00	9	54.00	708.00
39	ELECTRICAL SUCTION MACHINE	1	600	600	600	9	54.00	9	54.00	708.00
40	ELECTRIC STERILIZER	1	600	600	600	9	54.00	9	54.00	708.00
41	ELECTRIC SUCTION MACHINE	11	600	6600	6600	9	594.00	9	594.00	7,788.00
42	ELECTRICAL SUCTION MACHINE	26	600	15600	15600	9	1404.00	9	1404.00	18,408.00
43	ELECTRICAL SUCTION MACHNICE	10	600	6000	6000	9	540.00	9	540.00	7,080.00
44	ELECTRONIC BALANCE	1	500	500	500	9	45.00	9	45.00	590.00
45	EMG MACHINE	1	500	500	500	9	45.00	9	45.00	590.00
46	ENDOSCOPE MACHINE	2	450	900	900	9	81.00	9	81.00	1,062.00
47	ESR MACHINE	1	500	500	500	9	45.00	9	45.00	590.00
48	F A VALVE	19	450	8550	8550	9	769.50	9	769.50	10,089.00
49	FA VALVE	21	450	9450	9450	9	850.50	9	850.50	11,151.00
50	FETAL DOPPLER	1	450	450	450	9	40.50	9	40.50	531.00
51	FLOW METER *	150	300	45000	45000	9	4050.00	9	4050.00	53,100.00
52	FOGGER MACHINE	3	500	1500	1500	9	135.00	9	135.00	1,770.00
53	GLUCOMETER	22	400	8800	8800	9	792.00	9	792.00	10,384.00
54	HFNO MACHINE	5	500	2500	2500	9	225.00	9	225.00	2,950.00
55	HOLDER MACHINE	1	800	800	800	9	72.00	9	72.00	944.00
56	HOT AIR OVEN	3	800	2400	2400	9	216.00	9	216.00	2,832.00
57	HOT PLATE	1	500	500	500	9	45.00	9	45.00	590.00
58	INCUBATOR	3	500	1500	1500	9	135.00	9	135.00	1,770.00
59	INFUSION PUMP	12	500	6000	6000	9	540.00	9	540.00	7,080.00
60	INSSPISATOR	1	500	500	500	9	45.00	9	45.00	590.00
61	LAMINAR AIR FLOW	2	4000	8000	8000	9	720.00	9	720.00	9,440.00
62	LAMP	2	500	1000	1000	9	90.00	9	90.00	1,180.00
63	LIGHT SOURCE	2	500	1000	1000	9	90.00	9	90.00	1,180.00
64	MICROPIPETTE	19	800	15200	15200	9	1368.00	9	1368.00	17,936.00
65	MICROPLATE MIXER WITH ANLAZE	1	450	450	450	9	40.50	9	40.50	531.00
66	MICROSCOPE	1	500	500	500	9	45.00	9	45.00	590.00
67	MICROSCOPY	4	500	2000	2000	9	180.00	9	180.00	2,360.00
68	NEBULIZER	17	600	10200	10200	9	918.00	9	918.00	12,036.00
69	NEBULIZER MACHINE	14	600	8400	8400	9	756.00	9	756.00	9,912.00
70	NEEDLE CUTTER	1	450	450	450	9	40.50	9	40.50	531.00
71	OPERATING TABLE	2	450	900	900	9	81.00	9	81.00	1,062.00
72	OT LIGHT	1	500	500	500	9	45.00	9	45.00	590.00
73	OT LIGHT	2	500	1000	1000	9	90.00	9	90.00	1,180.00
74	OT LIGHT (D1)	1	500	500	500	9	45.00	9	45.00	590.00
75	OT LIGHT (D2)	3	500	1500	1500	9	135.00	9	135.00	1,770.00
76	OT LIGHT(D1)	10	500	5000	5000	9	450.00	9	450.00	5,900.00
77	OT LIGHT(D2)	10	500	5000	5000	9	450.00	9	450.00	5,900.00
78	OT LIGHT(D3)	5	500	2500	2500	9	225.00	9	225.00	2,950.00
79	OT LIGHT(D4)	3	500	1500	1500	9	135.00	9	135.00	1,770.00
80	OT-TABLE	1	450	450	450	9	40.50	9	40.50	531.00
81	P H METER	1	500	500	500	9	45.00	9	45.00	590.00
82	PACEMAKER	1	500	500	500	9	45.00	9	45.00	590.00
83	PATIENT MONITOR	126	500	63000	63000	9	5670.00	9	5670.00	74,340.00
84	PATIENT VENTILATOR	29	450	13050	13050	9	1174.50	9	1174.50	15,399.00
85	PFT MACHINE	1	450	450	450	9	40.50	9	40.50	531.00
86	PHACO MACHINE	2	450	900	900	9	81.00	9	81.00	1,062.00
87	PHOTOTHERAPY	5	400	2000	2000	9	180.00	9	180.00	2,360.00
88	PHOTOTHERAPY	5	400	2000	2000	9	180.00	9	180.00	2,360.00

TABLE LIGHT	2	500	1000	1000	9	90.00	9	90.00	1,180.00
PRESSURE GAUGE	6	200	1200	1200	9	108.00	9	108.00	1,416.00
PRESSURE GAUGE	2	200	400	400	9	36.00	9	36.00	472.00
PRESSURE GAUGE	10	200	2000	2000	9	180.00	9	180.00	2,360.00
89 PULSE OXIMETER	30	400	12000	12000	9	1080.00	9	1080.00	14,160.00
90 REFRIGERATOR	35	800	28000	28000	9	2520.00	9	2520.00	33,040.00
91 ROTARY SEAKEL	1	450	450	450	9	40.50	9	40.50	531.00
92 SLIT LAMP	1	450	450	450	9	40.50	9	40.50	531.00
93 STERILE AUTOCLAVE	1	450	450	450	9	40.50	9	40.50	531.00
94 SUCTION METER	191	300	57300	57300	9	5157.00	9	5157.00	67,614.00
95 SYRINGE PUMP	59	500	29500	29500	9	2655.00	9	2655.00	34,810.00
96 THERMOHYGROMETER	1	400	400	400	9	36.00	9	36.00	472.00
97 TMT MACHINE	1	450	450	450	9	40.50	9	40.50	531.00
98 TOURNIQUET	2	500	1000	1000	9	90.00	9	90.00	1,180.00
99 TOURNIQUET MACHINE	1	500	500	500	9	45.00	9	45.00	590.00
100 ULT DEEFPREEZER	1	500	500	500	9	45.00	9	45.00	590.00
101 USG MACHINE	1	450	450	450	9	40.50	9	40.50	531.00
102 VDRL ROTATOR	1	500	500	500	9	45.00	9	45.00	590.00
103 VORTEX MIXER	1	500	500	500	9	45.00	9	45.00	590.00
104 WATER BATH	1	400	400	400	9	36.00	9	36.00	472.00
105 WATER BATH & SHAKER	4	400	1600	1600	9	144.00	9	144.00	1,888.00
106 WEIGHT MACHINE	33	500	16500	16500	9	1485.00	9	1485.00	19,470.00
107 WEIGHT MACHINE (ANALOG)	3	500	1500	1500	9	135.00	9	135.00	1,770.00
108 WEIGHT MACHINE (DIGITAL)	1	500	500	500	9	45.00	9	45.00	590.00
109 WEIGHT MACHINE(ANALOG)	3	500	1500	1500	9	135.00	9	135.00	1,770.00
110 WEIGHT MACHINE(DIGI)	1	500	500	500	9	45.00	9	45.00	590.00
111 WEIGHT MACHINE(DIGITAL)	4	500	2000	2000	9	180.00	9	180.00	2,360.00
Total	1238		548500	0	548500	49365.00		49365.00	6,47,230.00

Amount In Words:-

RUPEES - SIX LAKH FOURTY SEVEN THOUSAND TWO HUNDRED THIRTY ONLY

Total Amount before Tax	5,48,500
Add: CGST	49,365.00
Add: SGST	49,365.00
Total Tax Amount	98,730.00
Total Amount after Tax:	6,47,230.00

GST on Reverse Charge
Certified that the particulars given above are true and correct

For AUTOCAL SYSTEMS



Bank Details
Bank A/C: 2111136159
Bank IFSC: KKBK0000728
BANK NAME: KOTAK MAHINDRA BANK
BRACH: SHUBHAMAGAL PLAZA TALEGAON CHOWK
Terms & conditions: 1) Payment Immediately through cheque/ DD, After completion of work as per P.O.

Receiver Sign

Authorised signatory

PORTABLE LIGHT	2	500	1000	1000	9	90.00	9	90.00	1,18
PRESSURE GAUGE	6	200	1200	1200	9	108.00	9	108.00	1,41
77 PRESSURE GAUGE	2	200	400	400	9	36.00	9	36.00	47
88 PRESSURE GAUGE	10	200	2000	2000	9	180.00	9	180.00	2,36
89 PULSE OXIMETER	30	400	12000	12000	9	1080.00	9	1080.00	14,16
90 REFRIGERATOR	35	800	28000	28000	9	2520.00	9	2520.00	33,04
91 ROTARY SEAKEL	1	450	450	450	9	40.50	9	40.50	53
92 SLIT LAMP	1	450	450	450	9	40.50	9	40.50	53
93 STERILE AUTOCLAVE	1	450	450	450	9	40.50	9	40.50	53
94 SUCTION METER	191	300	57300	57300	9	5157.00	9	5157.00	67,614
95 SYRINGE PUMP	59	500	29500	29500	9	2655.00	9	2655.00	34,810
96 THERMOHYGROMETER	1	400	400	400	9	36.00	9	36.00	472
97 TMT MACHINE	1	450	450	450	9	40.50	9	40.50	531
98 TOURNIQUET	2	500	1000	1000	9	90.00	9	90.00	1,180
99 TOURNIQUET MACHINE	1	500	500	500	9	45.00	9	45.00	590
100 ULT DEEPFREEZER	1	500	500	500	9	45.00	9	45.00	590
101 USG MACHINE	1	450	450	450	9	40.50	9	40.50	531
102 VDRL ROTATOR	1	500	500	500	9	45.00	9	45.00	590
103 VORTEX MIXER	1	500	500	500	9	45.00	9	45.00	590
104 WATER BATH	1	400	400	400	9	36.00	9	36.00	472
105 WATER BATH & SHAKER	4	400	1600	1600	9	144.00	9	144.00	1,888
106 WEIGHT MACHINE	33	500	16500	16500	9	1485.00	9	1485.00	19,470
107 WEIGHT MACHINE (ANALOG)	3	500	1500	1500	9	135.00	9	135.00	1,770
108 WEIGHT MACHINE (DIGITAL)	1	500	500	500	9	45.00	9	45.00	590
109 WEIGHT MACHINE(ANALOG)	3	500	1500	1500	9	135.00	9	135.00	1,770
110 WEIGHT MACHINE(DIGI)	1	500	500	500	9	45.00	9	45.00	590
111 WEIGHT MACHINE(DIGITAL)	4	500	2000	2000	9	180.00	9	180.00	2,360

Total	1238	548500	0	548500	49365.00	49365.00	6,47,230.00
--------------	------	--------	---	--------	----------	----------	-------------

Amount in Words:-

RUPEES - SIX LAKH FOURTY SEVEN THOUSAND TWO HUNDRED THIRTY ONLY


Total Amount before Tax	5,48,500.00
Add: CGST	49,365.00
Add: SGST	49,365.00
Total Tax Amount	98,730.00
Total Amount after Tax:	6,47,230.00
GST on Reverse Charge	

Certified that the particulars given above are true and correct

For AUTOCL SYSTEMS

Bank Details
 Bank A/C: 2111136159
 Bank IFSC: KKBK0000728
 BANK NAME: KOTAK MAHINDRA BANK
 BRACH: SHUBHAMAGAL PLAZA TALEGAON CHOWK

Terms & conditions:
 () Payment Immediately through cheque/ DD,
 After completion of work as per P.O.



Receiver Sign

Authorised signatory

hali



Dr. Anil T. Deshmukh
M.D. (Pathology)
DEAN

SHRI SHIVAJI EDUCATION SOCIETY, AMRAVATI'S
Dr. Panjabrao Alias Bhausaheb Deshmukh
Memorial Medical College
Shivaji Nagar, Amravati - 444 603



Harshvardhan P. Deshmukh
PRESIDENT



• Office Tel. (0721) 2552353 • Fax. (0721) 2552353 • E-mail drpdmmc2007@rediffmail.com drpdmmcamravati@gmail.com • Website http://pdmmc.edu.in

Summary

Medical Gas & Vacuum System

Total No. of Oxygen Point - 950 (248 AMC)

Total No. of Vacuum Point - 149

Total No. of Air Point - 60

Medical Gas & Vacuum System AMC Given to Vinayak Agency , Amravati.

I/C Repair Section
Dr. P.D.M.M.C. Amravati

Chairperson - Criteria No. _
NAAC Steering Committee
Dr. P. D. M. M. C. Amravati



SHRI SHIVAJI EDUCATION SOCIETY, AMRAVATI'S
Dr. Panjabrao Alias Bhausahab Deshmukh
Memorial Medical College
 Shivaji Nagar, Amravati - 444 603



Dr. Anil T. Deshmukh
 M.D. (Pathology)
 DEAN

Harshvardhan P. Deshmukh
 PRESIDENT



Office: Tel. (0721) 2552353 • Fax.: (0721) 2552353 • E-mail: drpdmmc2007@rediffmail.com, drpdmmcamravati@gmail.com • Website: http://pdmmc.edu.in

Planned Preventive Maintenance for Medical Gas Pipeline 2022-2023

SR NO	LOCATION	NAME OF EQUIPMENTS	QTY	TYPE OF CONTRACT	AMC/CMC CONTRACT PERIOD		Plane Preventive Maintenance								NAME OF SERVICE PROVIDERS
					From	To	PMS 1 st		PMS 2 nd		PMS 3rd		PMS 4th		
							Due	Done	Due	Done	Due	Done	Due	Done	
1	GAS PLANT	VACCUME 1	1	AMC	10-01-2022	30/09/2023	Dec-22	Dec-22	Mar-23	Mar-23	Jun-23	Jun-23	Sep-23		Vinayak Agency, Amravati
2		VACCUME 2	1	AMC	10-01-2022	30/09/2023	Dec-22	Dec-22	Mar-23	Mar-23	Jun-23	Jun-23	Sep-23		Vinayak Agency, Amravati
3		VACCUME 3	1	AMC	10-01-2022	30/09/2023	Dec-22	Dec-22	Mar-23	Mar-23	Jun-23	Jun-23	Sep-23		Vinayak Agency, Amravati
4		VACCUME 4	1	AMC	10-01-2022	30/09/2023	Dec-22	Dec-22	Mar-23	Mar-23	Jun-23	Jun-23	Sep-23		Vinayak Agency, Amravati
5		AIR COMPRESSOR 1	1	AMC	10-01-2022	30/09/2023	Mar-23	Mar-23	Sep-23		NIL	NIL	NIL	NIL	Vinayak Agency, Amravati
6		AIR COMPRESSOR 2	1	AMC	10-01-2022	30/09/2023	Mar-23	Mar-23	Sep-23		NIL	NIL	NIL	NIL	Vinayak Agency, Amravati
7		AIR COMPRESSOR 3	1	AMC	10-01-2022	30/09/2023	Mar-23	Mar-23	Sep-23		NIL	NIL	NIL	NIL	Vinayak Agency, Amravati
8		AIR COMPRESSOR 4	1	AMC	10-01-2022	30/09/2023	Mar-23	Mar-23	Sep-23		NIL	NIL	NIL	NIL	Vinayak Agency, Amravati
9		MANIFOLD 1	1	AMC	10-01-2022	30/09/2023	Mar-23	Mar-23	Sep-23		NIL	NIL	NIL	NIL	Vinayak Agency, Amravati
10		MANIFOLD 2	1	AMC	10-01-2022	30/09/2023	Mar-23	Mar-23	Sep-23		NIL	NIL	NIL	NIL	Vinayak Agency, Amravati

11		MANIFOLD 3	1	AMC	10-01-2022	30/09/2023	Mar-23	Mar-23	Sep-23		NIL	NIL	NIL	NIL	Vinayak Agency, Amravati
12		MANIFOLD 4	1	AMC	10-01-2022	30/09/2023	Mar-23	Mar-23	Sep-23		NIL	NIL	NIL	NIL	Vinayak Agency, Amravati
13	ALL WARDS+ ICU+ OT	OXYGEN OUTLETS	248	AMC	10-01-2022	30/09/2023	Mar-23	Mar-23	Sep-23		NIL	NIL	NIL	NIL	Vinayak Agency, Amravati
14	ALL WARDS+ ICU+ OT	VACCUME OUTLET	149	AMC	10-01-2022	30/09/2023	Mar-23	Mar-23	Sep-23		NIL	NIL	NIL	NIL	Vinayak Agency, Amravati
15	ALL WARDS+ ICU+ OT	AIR OUTLETS	60	AMC	10-01-2022	30/09/2023	Mar-23	Mar-23	Sep-23		NIL	NIL	NIL	NIL	Vinayak Agency, Amravati

Handwritten signature

Handwritten checkmark



Summary

Maintenance of potable water

- Potability is check by microbiology dept. every three months.
- Report are attached.

I/C Repair Section
Dr. P.D.M.M.C. Amravati

TEKADE AND COMPANY

Rahatgaon Main Road, In Front of Pragati Vidyalaya Rahatgaon, Amravati - 444 602

Mob. 9881665255

GST No. 27ICCPK4715A1ZX

130132

Pan No. ICCPK4715A

Name The DEAN. DR. P.D.M.M.C Amravati Date: 28/11

Address Shivaji Nagar Amravati - 444603

Contact No. Tel: (0721) 2552353. GSTIN: 27AAETS1500P2ZA

Sr.No.	Particulars	Quantity	Rate	Amount
1)	40/40 water cooler 40 liter storage water cooler. Tap: 2 Make: shridam Refrigeration. Body: Full SS.	1	25000	25000.00
			GST Included	
In words <u>Twenty five thousands only.</u>			Total	25000.00


Bank Details : Bank Name : HDFC Bank (SHEGAON NAKA)
Bank Account Number : 50200049318560
IFSC Code : HDFC0002731

For - **TEKADE AND COMPANY**

GST Type : Composition taxable dealer

Declaration : We declare that this invoice shows

The actual price of the goods of that all Particular are true & Correct.


Authorized Sign.

Terms & Condition : (1) Goods once sale will not taken back or exchange (2) No responsibility for any damage / Loss / Breakage in tran

Dr. Panjabrao Alias Bhausahab Deshmukh Memorial Medical College
Shivaji Nagar, Amravati - 444 603
(An ISO 9001 : 2000 Certified Institution)

Dr. Anil Deshmukh
M.D. (Pathology)
DEAN

Harshwardhan Deshmukh
PRESIDENT

• Office : Tel.(0721) 2552353 Fax : (0721) 2552353
• E-mail : drpdmmc2007@rediffmail.com Website : www.pdmmc.com

No. PDMMC/3050/2022

Date : 19/11/2022

To.
M/s. Tekade and Company,
Rahatgaon Main Road,
Near Pragati, Vidyalaya Rahatgaon,
Ta.Dost. Amravati - 444 602
Mob. 9881665255

Subject :- Regarding the supply for Water Cooler.

Reference :- 1) Your Quotation dt.18/11/2021.
2) Your Negotiation Letter dt.2/12/2021.

Sir,

With reference to above subject, we are pleased to place the supply Order for following as per the above reference letter. Please supply the Water Cooler as per order at the earliest.

Sr. No	Item of Specification	Total Quantity	Price Each
1	<u>Water Cooler (Stainless Steel)</u> 40 Liter Storage 40 Liter/Hr Cooling Two taps fully S.S. Make : Shriram	01 Nos.	Rs.25000.00

Dean
Dr. P. D. M. Medical Collage,
Amravati

Terms & Conditions :-

1. Rate Inclusive of all taxes with Installation F.O.R Ward No. 17/8
2. Delivery within 1-2 Week.
3. Payment after supply of goods within 30 days.
4. Warranty Three Years from the date of installation.
5. Pre-receipt should enclosed along with invoice, Rs.40.00 only postage charges of the cheque will be deducted.
6. Please mentioned the Institute GSTIN-27AAETS1500 P2ZA in your invoice.

Copy for Information to :-

1. I/C Sister Ward No. 7, Dr. P.D. Hospital, Amt.

Bill of Supply

TEKADE AND COMPANY

Rahatgaon Main Road, In Front of Pragati Vidyalaya Rahatgaon, Amravati - 444 602

Mob. 9881665255

GST No. 27ICCPK4715A1ZX

No 00135

Pan No. ICCPK4715A

Name The DEAN. PD. PDMMC Amravati Date: 29/12/22

Address Shivaji Nagar Amravati 444603.

Contact No. (0721) 2552353 GSTIN: 27AAETS1500P2ZA

Sr.No.	Particulars	Quantity	Rate	Amount
1)	JBM 25LPH RO Filter With Automatic on off System.	1	15000	15000.00
			GST Included	
In words <u>fifteen thousands only.</u>			Total	<u>15000.00</u>

Bank Details : Bank Name : HDFC Bank (SHEGAON NAKA)
Bank Account Number : 50200049318560
IFSC Code : HDFC0002731

For - **TEKADE AND COMPANY**

GST Type : Composition taxable dealer
Declaration : We declare that this invoice shows
The actual price of the goods of that all Particular are true & Correct.


Authorized Sign.

Terms & Condition : (1) Goods once sale will not taken back or exchange (2) No responsibility for any damage / Less / Breakage in transport

Bill of Supply

TEKADE AND COMPANY

Rahatgaon Main Road, In Front of Pragati Vidyalaya Rahatgaon, Amravati - 444 602

Mob. 9881665255

GST No. 27ICCPK4715A1ZX

No 00136

Pan No. ICCPK4715A

Name The DEAN. DR. PDMMC Amravati Date: 29/12/12

Address Shivaji Nagar Amravati 444603

Contact No. (0721) 2552353 GSTIN 27AAETS1500P2ZA

Sr.No.	Particulars	Quantity	Rate	Amount
1)	40 liter storage 40 liter/hr. cooling Make - shrinam Tap - 2 Body - fully ss.	1	25000	25000.00
			GST Included	
In words <u>Twenty five thousands only.</u>			Total	25000.00


Deed-06
P-154

GST Include

Bank Details : Bank Name : HDFC Bank (SHEGAON NAKA)
Bank Account Number : 50200049318560
IFSC Code : HDFC0002731

For - **TEKADE AND COMPANY**

GST Type : Composition taxable dealer
Declaration : We declare that this invoice shows
The actual price of the goods of that all Particular are true & Correct.


Authorized Sign.

Terms & Condition : (1) Goods once sale will not taken back or exchange (2) No responsibility for any damage / Less / Breakage in transport

SHRI SHIVAJI EDUCATION SOCIETY, AMRAVATI'S
(Registered Public Charitable Trust No. F/89)

Dr. Panjabrao Alias Bhausaheb Deshmukh Memorial Medical College
Shivaji Nagar, Amravati - 444 603
(An ISO 9001 : 2000 Certified Institution)

Dr. Anil Deshmukh
M.D. (Pathology)
DEAN

Harshwardhan Deshmukh
PRESIDENT

- Office : Tel.(0721) 2552353 Fax : (0721) 2552353
• E-mail : drpdmmc2007@rediffmail.com Website : www.pdmmc.com

No. PDMMC/ 10034/2022

Date : 24 /12/2022

To.
M/s. Tekade and Company,
Rahatgaon Main Road,
Near Pragati, Vidyalaya Rahatgaon,
Ta.Dost. Amravati - 444 602
Mob. 9881665255

Subject :- Regarding the supply for Water Cooler.

Reference :- 1) Your Quotation dt.18/11/2021.
2) Your Negotiation Letter dt.2/12/2021.

Sir,

With reference to above subject, we are pleased to place the supply Order for following as per the above reference letter. Please supply the Water Cooler as per order at the earliest.

Sr. No	Item of Specification	Total Quantity	Price Each
1	<u>Water Cooler (Stainless Steel)</u> 40 Liter Storage 40 Liter/Hr Cooling Two taps fully S.S. Make : Shriram (Ward No. 23,24 Gynaecology)	01 Nos.	Rs.25000.00

Dean
Dr. P. D. M. Medical Collage,
Amravati

Terms & Conditions :

1. Rate Inclusive of all taxes with Installation F.O.R. Ward No.23,24 Gynaecology.
2. Delivery within 1-2 Week.
3. Payment after supply of goods within 30 days.
4. Warranty Three Years from the date of installation.
5. Pre-receipt should enclosed along with invoice, Rs.40.00 only postage charges of the cheque will be deducted.
6. Please mentioned the Institute GSTIN-27AAETS1500 P2ZA in your invoice.

Copy for Information to :-

1. I/C Sister Ward No. 23,24 Gynaecology, Dr.P.D.Hospital, Amt.

SHRI SHIVAJI EDUCATION SOCIETY, AMRAVATI'S
(Registered Public Charitable Trust No. F/89)

Dr. Panjabrao Alias Bhausaheb Deshmukh Memorial Medical College
Shivaji Nagar, Amravati - 444 603
(An ISO 9001 : 2000 Certified Institution)

Dr. Anil Deshmukh
M.D. (Pathology)
DEAN

Harshwardhan Deshmukh
PRESIDENT

• Office : Tel.(0721) 2552353

Fax : (0721) 2552353

• E-mail : drpdmmc2007@rediffmail.com

Website : www.pdmmc.com

No. PDMMC/10044/2022

Date : 24/12/2022

To.
M/s. Tekade and Company,
Rahatgaon Main Road,
Near Pragati, Vidyalaya Rahatgaon,
Ta.Dost. Amravati - 444 602
Mob. 9881665255

Subject :- Regarding the supply for R. O. Filter.

Reference :- 1) Your Quotation dt.18/11/2021
2) Your Negotiation Letter dt.2/12/2021.

Sir,

With reference to above subject, we are pleased to place the supply Order for following as per the above reference letter. Please supply the R. O. Filter as per order at the earliest.

Sr. No	Item of Specification	Total Quantity	Price Each (Inclusive of all taxes)
1	JBM 25 LPH RO Filter with Automatic on off system (FOR Girl's Hostel)	01 Nos.	Rs.15000.00

Dean

Dr. P. D. M. Medical Collage,
Amravati

Terms & Conditions :-

1. Rate Inclusive of all taxes with Installation F.O.R. Girl's Hostel.
2. Delivery within 1-2 Week.
3. Payment after supply of goods within 30 days.
4. Warranty Three Years from the date of installation.
5. Pre-receipt should enclosed along with invoice, Rs.40.00 only postage charges of the cheque will be deducted.
6. Please mentioned the Institute GSTIN-27AAETS1500 P2ZA in your invoice.

Copy for Information to :-



**DR. PANJABRAO ALIAS BHAUSAHEB DESHMUKH MEMORIAL
MEDICAL COLLEGE AND HOSPITAL**

Panchawati Square, Amravati, Maharashtra, INDIA-444603 Phone:7212662323

Email:drpdhrc2015@rediffmail.com Website:http://pdmmc.edu.in

W-53

MICROBIOLOGY BACTERIOLOGY LABORATORY REPORT

Patient Name	: MR M/S DR P D M M C HOSPITAL INTERN HOSTEL WATER COOLER	Lab No.	:
UHID	: PDMC.0000048820	Collection Date Time	: 11/01/2023 11:40 AM
Age	: 1 Years	Receiving Date Time	: 11/01/2023 11:40 AM
Sex	: Male	Reporting Date Time	: 13/01/2023 11:13 AM
Referred By	: DR. EMERGENCY MEDICINE	Visit No.	: OP/0123/012046
Ordered Location	: /Emergency Medicine	Barcode No.	: 3ABA35106

Test (Method)	Result	Units	Ref Range	Sample
---------------	--------	-------	-----------	--------

Water Potability Test

Result (WP)

MPN for Presumptive
coliform count is less
than one (1).
Excellent for drinking.

xxxx END OF REPORT xxxx

Technician

Pathologist

Biochemist

Nyhal 13/1/23
Microbiologist

Assistant Professor
Department of Microbiology
Dr.P.D.M.M.College,Amravati

पाणी सुरक्षा विभाग
डॉ. पं. वे. जय



W-48

MICROBIOLOGY BACTERIOLOGY LABORATORY REPORT

Patient Name	: MR M/S DR P D M M C HOSPITAL GIRL HOSTEL COOLER	Lab No.	:
UHID	: PDMC.0000048770	Collection Date Time	: 11/01/2023 11:31 AM
Age	: 1 Years	Receiving Date Time	: 11/01/2023 11:32 AM
Sex	: Male	Reporting Date Time	: 13/01/2023 11:18 AM
Referred By	: DR. EMERGENCY MEDICINE	Visit No.	: OP/0123/011981
Ordered Location	: /Emergency Medicine	Barcode No.	: 3A8A35090

Test (Method)	Result	Units	Ref Range	Sample
---------------	--------	-------	-----------	--------

Water Potability Test

Result (WP)	MPN for Presumptive coliform count is less than one (1). Excellent for drinking.
-------------	---

xxxx END OF REPORT xxxx

Technician

Pathologist

Biochemist

Nyhal 13/1/23
Microbiologist

Assistant Professor
Department of Microbiology
Dr.P.D.M.M.College,Amravati



DR. PANJABRAO ALIAS BHAUSAHEB DESHMUKH MEMORIAL MEDICAL COLLEGE AND HOSPITAL

Panchawati Square, Amravati, Maharashtra, INDIA-444603 Phone:7212662323

Email:drpdhrc2015@rediffmail.com Website:http://pdmmc.edu.in

W-49

MICROBIOLOGY BACTERIOLOGY LABORATORY REPORT

Patient Name	: MR M/S DR P D M M C HOSPITAL BOYS HOSTEL WATER COOLER	Lab No.	:
UHID	: PDMC.0000048798	Collection Date Time	: 11/01/2023 11:36 AM
Age	: 1 Years	Receiving Date Time	: 11/01/2023 11:37 AM
Sex	: Male	Reporting Date Time	: 13/01/2023 11:17 AM
Referred By	: DR. EMERGENCY MEDICINE	Visit No.	: OP/0123/012015
Ordered Location	: /Emergency Medicine	Barcode No.	: 3A8A35101

Test (Method)	Result	Units	Ref Range	Sample
---------------	--------	-------	-----------	--------

Water Potability Test

Result (WP)	MPN for Presumptive coliform count is less than one (1). Excellent for drinking.
-------------	---

xxxx END OF REPORT xxxx

Technician

Pathologist

Biochemist

Nyhal 13/1/23
Microbiologist



Panchawati Square, Amravati, Maharashtra, INDIA-444603 Phone:7212662323

Email:drpdhrc2015@rediffmail.com Website:http://pdmmc.edu.in

W-50

MICROBIOLOGY BACTERIOLOGY LABORATORY REPORT

Patient Name	: MR M/S DR P D M M C HOSPITAL NURSING HOSTEL WATER COOLER	Lab No.	:
UHID	: PDMC.0000048864	Collection Date Time	: 11/01/2023 11:48 AM
Age	: 1 Years	Receiving Date Time	: 11/01/2023 11:49 AM
Sex	: Male	Reporting Date Time	: 13/01/2023 11:16 AM
Referred By	: DR. EMERGENCY MEDICINE	Visit No.	: OP/0123/012102
Ordered Location	: /Emergency Medicine	Barcode No.	: 3A8A35108

Test (Method)	Result	Units	Ref Range	Sample
Water Potability Test				Sample

Result (WP) MPN for Presumptive coliform count is less than one (1).
Excellent for drinking.

xxxx END OF REPORT xxxx

Technician

Pathologist

Biochemist

Nyhal
Microbiologist 13/1/23

Assistant Professor
Department of Microbiology
Dr. P.D.M.M.College, Amravati



DR. PANJABRAO ALIAS BHAUSAHEB DESHMUKH MEMORIAL MEDICAL COLLEGE AND HOSPITAL

Panchawati Square, Amravati, Maharashtra, INDIA-444603 Phone:7212662323

Email:drpdhrc2015@rediffmail.com Website:http://pdmmc.edu.in

W-51

MICROBIOLOGY BACTERIOLOGY LABORATORY REPORT

Patient Name	: MR M/S DR P D M M C HOSPITAL LIBRARY WATER COOLER	Lab No.	:
UHID	: PDMC.0000048920	Collection Date Time	: 11/01/2023 12:00 PM
Age	: 1 Years	Receiving Date Time	: 11/01/2023 12:01 PM
Sex	: Male	Reporting Date Time	: 13/01/2023 11:15 AM
Referred By	: DR. EMERGENCY MEDICINE	Visit No.	: OP/0123/012170
Ordered Location	: /Emergency Medicine	Barcode No.	: 3A8A35135

Test (Method)	Result	Units	Ref Range	Sample
Water Potability Test				Sample

Result (WP) MPN for Presumptive coliform count is less than one (1).
Excellent for drinking.

xxxx END OF REPORT xxxx

Technician

Pathologist

Biochemist

Nyhal
Microbiologist 13/1/23

पंचवती परामर्श विभाग
13



**DR. PANJABRAO ALIAS BHAUSAHEB DESHMUKH MEMORIAL
MEDICAL COLLEGE AND HOSPITAL**

Panchawati Square, Amravati, Maharashtra, INDIA-444603 Phone:7212662323

Email:drpdhrc2015@rediffmail.com Website:http://pdmcc.edu.in

W-52

MICROBIOLOGY BACTERIOLOGY LABORATORY REPORT

Patient Name	: MR M/S DR P D M M C HOSPITAL PG HOSTEL WATER COOLER	Lab No.	:
UHID	: PDMC.0000048842	Collection Date Time	: 11/01/2023 11:44 AM
Age	: 1 Years	Receiving Date Time	: 11/01/2023 11:45 AM
Sex	: Male	Reporting Date Time	: 13/01/2023 11:14 AM
Referred By	: DR. EMERGENCY MEDICINE	Visit No.	: OP/0123/012074
Ordered Location	: /Emergency Medicine	Barcode No.	: 3A8A35107

Test (Method)	Result	Units	Ref Range	Sample
Water Potability Test				Sample

Result (WP)

MPN for Presumptive coliform count is less than one (1).
Excellent for drinking.

xxxx END OF REPORT xxxx

Technician

Pathologist

Biochemist

Nyhet - 13/1/23
Microbiologist

Assistant Professor
Department of Microbiology
Dr. P.D.M.M.College, Amravati



**DR. PANJABRAO ALIAS BHAUSAHEB DESHMUKH MEMORIAL
MEDICAL COLLEGE AND HOSPITAL**

Panchawati Square, Amravati, Maharashtra, INDIA-444603 Phone:7212662323

Email:drpdhrc2015@rediffmail.com Website:http://pdmcc.edu.in

W-54

MICROBIOLOGY BACTERIOLOGY LABORATORY REPORT

Patient Name	: MR M/S DR P D M M C HOSPITAL DEAN OFFICE WATER	Lab No.	:
UHID	: PDMC.0000048965	Collection Date Time	: 11/01/2023 12:15 PM
Age	: 1 Years	Receiving Date Time	: 11/01/2023 12:16 PM
Sex	: Male	Reporting Date Time	: 13/01/2023 11:12 AM
Referred By	: DR. EMERGENCY MEDICINE	Visit No.	: OP/0123/012224
Ordered Location	: /Emergency Medicine	Barcode No.	: 3A8A35136

Test (Method)	Result	Units	Ref Range	Sample
Water Potability Test				Sample

Result (WP)

MPN for Presumptive coliform count is less than one (1).
Excellent for drinking.

xxxx END OF REPORT xxxx

पाणी पुरवठा विभाग
डॉ. पं. दे. वि. वि. वि. वि.

Nyhet



**DR. PANJABRAO ALIAS BHAUSAHEB DESHMUKH MEMORIAL
MEDICAL COLLEGE AND HOSPITAL**

Panchawati Square, Amravati, Maharashtra, INDIA-444603 Phone:7212662323

Email:drpdhrc2015@rediffmail.com Website:http://pdmmc.edu.in

W-46

MICROBIOLOGY BACTERIOLOGY LABORATORY REPORT

Patient Name : MR M/S DR P D M M C HOSPITAL
OPD WATER COOLER Lab No. :
UHID : PDMC.0000048887
Age : 2 Years Collection Date Time : 11/01/2023 11:52 AM
Sex : Male Receiving Date Time : 11/01/2023 11:53 AM
Referred By : DR. EMERGENCY MEDICINE Reporting Date Time : 13/01/2023 11:19 AM
Ordered Location : /Emergency Medicine Visit No. : OP/0123/012131
Barcode No. : 3A8A35127

Test (Method)	Result	Units	Ref Range	Sample
---------------	--------	-------	-----------	--------

Water Potability Test

Result (WP) : MPN for Presumptive coliform count is less than one (1). Excellent for drinking.

xxxx END OF REPORT xxxx

Technician

Pathologist

Biochemist

Nyhat 13/1/23
Microbiologist
Assistant Professor
Department of Microbiology
Dr.P.D.M.M.College,Amravati



**DR. PANJABRAO ALIAS BHAUSAHEB DESHMUKH MEMORIAL
MEDICAL COLLEGE AND HOSPITAL**

Panchawati Square, Amravati, Maharashtra, INDIA-444603 Phone:7212662323

Email:drpdhrc2015@rediffmail.com Website:http://pdmmc.edu.in

W-47

MICROBIOLOGY BACTERIOLOGY LABORATORY REPORT

Patient Name : MR M/S DR P D M MC HOSPITAL
NEAR MICU WATER COOLER Lab No. :
UHID : PDMC.0000048897
Age : 1 Years Collection Date Time : 11/01/2023 11:56 AM
Sex : Male Receiving Date Time : 11/01/2023 11:56 AM
Referred By : DR. EMERGENCY MEDICINE Reporting Date Time : 13/01/2023 11:18 AM
Ordered Location : /Emergency Medicine Visit No. : OP/0123/012146
Barcode No. : 3A8A35134

Test (Method)	Result	Units	Ref Range	Sample
---------------	--------	-------	-----------	--------

Water Potability Test

Result (WP) : MPN for Presumptive coliform count is less than one (1). Excellent for drinking.

xxxx END OF REPORT xxxx

Technician

Pathologist

Biochemist

Nyhat 13/1/23
Microbiologist
Assistant Professor



Summary

- **No. of DG sets** – 03 (Kirloskar)
 - 1) 250 KVA
 - 2) 160 KVA
 - 3) 62.5 KVA
- **Name of Agency** that looks after monthly audit – Dickson Engineering, Nagpur .
- **Daily Maintenance & breakdown Record** - yes (Maintained by Electrical Dept.)
- **Solar Plant** available in campus – (430kwp Grid Tied Solar Plant) Installed by PROVEN CONSULTING SERVICES, PUNE.
- **No. of Lift** - 02 (AMC look after OTIS ELEVATOR INDIA)

I/C Repair Section
Dr. P.D.M.M.C. Amravati

ELECTRICAL ENGINEER
DR.PDMMC, AMRAVATI

Chairperson - Criteria No. _
NAAC Steering Committee
Dr. P. D. M. M. C. Amravati



Electronic Field Service Report (eFSR)

Customer Name :	Shri Shivaji Education Society	Genset Serial Number:	E116004045
S. R. Number:	207782427	Engine Application Code:	6H.8404...
Task Start Date:	03 Jan 2022 06:34:52 PM	Engine Serial Number: -	1620166
Task End Date:	04 Jan 2022 10:48:26 AM	Product Segment:	MkVA
Total Running Hours:	211	Engine Model:	6K1080TA G2
SR Type:	KOEL Bandhan	Dealer Name:	419982_4 Dicksons Engineering Co.Pvt.Ltd. - AMRAVATI
SR Sub Type:	CM	State:	MAHARASHTRA
Capacity (kVA):	160	Commissioning Date:	04 Jul 2016
Service ID:	100150088	Site Address: Dr Pan Jabrao Alias Bhausahab Deshmukh Memorial Medical College, Shivaji Nagar, Amravati, Maharashtra, Amravati, Amravati, M	

D G Set Parameters

Load_A: 123 Amp	Load_Y: 121 Amp	Load_B: 121 Amp
Lube Oil Pressure: 4.7	Lube Oil Temp: 70 °C	Coolant Temp: 60 °C
Voltage: 415	Frequency: 50	Ambient temp.(Air temp. near Air Cleaner Element): 60

Safeties

Low Lube Oil Pressure:	WORKING	V Belt Failure (Air cooled):	WORKING
High Lube Oil Temp:	WORKING	Coolant Level (Liquid Cooled):	WORKING
Coolant Temp (Liquid Cooled):	WORKING		

DG Check Sheet

No.	Check Points	Action Taken
Air Intake System		
1	Air Cleaner (Pre Element) Dry Type:	Found OK
2	Air Cleaner (Safety Element) Dry Type:	Found OK
3	Restriction Or Vacuumindicator Operation:	Found OK
4	Hose:	Found OK
5	Hose Clamp:	Found OK
6	Air Cleaner Housing Cap:	Found OK
7	CAC Or Intercooler Fins:	Found OK
Lubrication System		
8	Lube Oil Level:	Found OK
9	Oil Leakage:	Found No leakage
10	Lube Oil Filter:	Found OK
		Note: Filter change period is every 500 hrs. or 6 months or every oil change
Cooling System		
11	Coolant Level:	Found OK
12	Coolant pH Testing:	Found OK(value between 7 to 9)
13	Coolant Leakage:	Found No leakage
14	Fan Belt:	Found OK
15	Radiator Pressure Cap (Rubber gasket and Spring):	Found OK

Our Products and Services

<p>KOEL CARE Repowering Flow of life for your equipment</p>	<p>KOEL EXTENDED CARE WARRANTY Extended peace of mind For Earthmoving Equipment Engines Only</p>	<p>BA DHAN PEACE OF MIND Unique Service Package</p>	<p>KOEL CARE Genuine Oils and Coolant</p>	<p>Auto Mains Failure Panel for Koel Green Gensets</p>
--	---	--	--	---

[Signature]
I/C Repair Section

[Signature]
Chairperson - Criteria No. -
NAAC Steering Committee
Dr. P. D. M. M. C. Amravati



Electronic Field Service Report (eFSR)

Account Details			
Account No.	400874978	Account Name	Shri Shivaji Education Society
Customer Type	Individual Customer	Email	electricpdmc@gmail.com
Contact No.	9922149351	City	Amravati
Code	444603	District	Amravati

Asset Parameters	
Reason Of Failure	d.g. auto starting problem
Problem Summary	ok
Work Done	d.g. silekter switch wiring proper fitment & ok
Final Remark	ok
Issue	AUTOMATION ISSUE
Customer Name	P.d. d. amc
Contact No.	8999491622
Technician Remark	good job
Customer Remark	

Customer Photo & signature	Service Engineer Photo & signature
<p>04-01-22 10:49 AM Latitude: 20°50'21.00" Longitude: 77°78'04.23"</p>	

Our Products and Services

<p>KOEL CARE EXTENDED WARRANTY Extended peace of mind For Earthmoving Equipment Engines Only</p>	<p>BA DHAN PEACE OF MIND Unique Service Package</p>	<p>KOEL CARE Genuine Oils and Coolant</p>	<p>Auto Mains Failure Panel for Koel Green Gensets</p>
---	--	--	---



Electronic Field Service Report (eFSR)

Customer Name :	Shri Shivaji Education Society		
Machine Number:	207796171	Genset Serial Number:	E116003924
Start Date:	07 Jan 2022 09:12:04 AM	Engine Application Code:	F6.8736...
End Date:	07 Jan 2022 10:51:56 AM	Engine Serial Number:	1620112
Running Hours:	243	Product Segment:	HKVA
Machine Type:	KOEL Bandhan	Engine Model:	6SL1500TA G3
Machine Sub Type:	CM	Dealer Name:	419982_4 Dicksóns Engineering Co.Pvt.Ltd. - AMRAVATI
Machine Age:	250	State:	MAHARASHTRA
Machine No.:	100149626	Commissioning Date:	15 Jun 2016
Customer Site ID / SAP ID			
Address:	Dr Pan Jabrgo Alias Bhausahab Deshmukh Memorial Medical College, Shivaji Nagar, Amravati, Maharashtra, Amravati, Amravati, N		

D G Set Parameters

Load_R: 123 Amp	Load_Y: 123 Amp	Load_B: 122 Amp
Oil Pressure: 4.7	Lube Oil Temp: 70 °C	Coolant Temp: 60 °C
Frequency: 415	Frequency: 50	Ambient temp. (Air temp. near Air Cleaner Element): 60

Safeties

Lube Oil Pressure:	WORKING	V Belt Failure (Air cooled):	WORKING
Lube Oil Temp:	WORKING	Coolant Level(Liquid Cooled):	WORKING
Ambient Temp(Liquid Cooled):	WORKING	Over Speed:	WORKING

DG Check Sheet

Check Points	Action Taken
Radiator fan alignment w.r.t.shroud:	OK
Fan drive bracket bolt tightness:	OK
Fan Belt Tension:	OK
Fan Belt Condition:	OK
Water Pump Belt Condition:	OK
Water Pump Belt Tension:	OK
Oil leakage from front oil seal:	OK
Oil, Coolant leakage from header assembly:	OK
Clutch resistance Or operation:	OK
Fuel Leakage:	OK
Condition of Fuel Hoses:	OK
Supporting of fuel hoses, check for fouling, condition of bradding:	OK
Oil leakage at Actuator:	OK
Oil leakage from rocker cover Or cylinder head:	OK
Engine mount bolt tightness:	OK
Alternator bolt tightness:	OK

Our Products and Services

KOEL CARE EXTENDED WARRANTY
Extended peace of mind
For Earthmoving Equipment Engines Only

BA DHAN
Unique Service Package

KOEL CARE Genuine Oils and Coolant

Auto Mains Failure Panel for Koel-Green Gensets



Electronic Field Service Report (eFSR)

Account Details			
Account No.	400874978	Account Name	Shri Shivaji Education Society
Type	Individual Customer	Email	electricpdmc@gmail.com
Contact No.	9922149351	City	Amravati
Pin Code	444603	District	Amravati

Asset Parameters	
Nature Of Failure	d.g. starting problem
Problem Summary	ok
Action Taken	d.g. battery connection properly fitment panel mcb wiring fitment & ok
Engineer Remark	ok
DC	Starting issue
Customer Name	Purstam
Contact No.	8999491622
Customer Remark	good job
Acceptance Remark	

Customer Photo & signature		Service Engineer Photo & signature	

Helped the customer to Register on KOEL CONNECT Application		YES	
Customer Name :	Purstam	Engineer Name :	KEDARSINGH BINJWAD
Contact No. :	8999491622	Pulse Id :	4199820027

Our Products and Services

KOEL CARE
Renewing
every 1000 hrs for your equipment

KOEL EXTENDED WARRANTY
Extended peace of mind
For Earthmoving Equipment
Engines Only

BA DHAN
Choice Unlimited
Unique Service Package

**KOEL CARE Genuine Oils
and Coolant**

**Auto Mains Failure Panel
for Koel Green Gensets**



Electronic Field Service Report (eFSR)

Customer Name :	Shri Shivaji Education Society		
S. R. Number:	207796185	Genset Serial Number:	88888888
Task Start Date:	07 Jan 2022 10:27:06 AM	Engine Application Code:	4H.3048...
Task End Date:	07 Jan 2022 10:33:43 AM	Engine Serial Number:	1321520
Total Running Hours:	1786	Product Segment:	MKVA
SR Type:	KOEL Bandhan	Engine Model:	4R1040
SR Sub Type:	BD	Dealer Name:	419982_4 Dicksons Engineering Co.Pvt.Ltd. - AMRAVATI
kVA:	40	State:	MAHARASHTRA
Instance ID:	3294702	Commissioning Date:	24 Oct 2013
Site Address:	Dr Pan Jabrao Alias Bhausahab Deshmukh Memorial Medical College, Shivaji Nagar, Amravati, Maharashtra, Amravati, Amravati, MAHARASHTRA		

D G Set Parameters

Load_R : Amp	Load_Y : Amp	Load_B : Amp
Lube Oil Pressure: 4	Lube Oil Temp: °C	Coolant Temp : 75 °C
Voltage: 415	Frequency: 50	Ambient temp.(Air temp. near Air Cleaner Element):

Safeties

Low Lube Oil Pressure:	WORKING	V Belt Failure (Air cooled):	WORKING
High Lube Oil Temp:	WORKING	Coolant Level (Liquid Cooled):	WORKING
Coolant Temp (Liquid Cooled):	WORKING		

DG Check Sheet

No.	Check Points	Action Taken
Air Intake System		
1	Air Cleaner (Pre Element) Dry Type:	Found OK
2	Air Cleaner (Safety Element) Dry Type:	Found OK
3	Restriction Or Vacuumindicator Operation:	Found OK
4	Hose:	Found OK
5	Hose Clamp:	Found OK
6	Air Cleaner Housing Cap:	Found OK
7	CAC Or Intercooler Fins:	Found OK
Lubrication System		
8	Lube Oil Level:	Found OK
9	Oil Leakage:	Found No leakage
10	Lube Oil Filter:	Found OK Note: Filter change period is every 500 hrs. or 6 months or every oil change
Cooling System		
11	Coolant Level:	Found OK
12	Coolant pH Testing:	Found OK(value between 7 to 9)
13	Coolant Leakage:	Found No leakage
14	Fan-Belt:	Found OK
15	Radiator Pressure Cap (Rubber gasket and Spring):	Found OK

Our Products and Services

<p>KOEL CARE Recovering the life for your equipment</p>	<p>KOEL CARE EXTENDED WARRANTY Extended peace of mind For Earthmoving Equipment Engines Only</p>	<p>BA DHAN Unique Service Package</p>	<p>KOEL CARE Genuine Oils and Coolant</p>	<p>Auto Mains Failure Panel for Koel Green Gensets</p>
--	---	--	--	---



Electronic Field Service Report (eFSR)

Account Details			
Int No.	400874978	Account Name	Shri Shivaji Education Society
	Individual Customer	Email	electricpdm@gmail.com
Act No.	9922149351	City	Amravati
Code	444603	District	Amravati

Asset Parameters	
Reason of Failure	oil leakages
Item Summary	ok
Work Done	engine oil level check OK v belt check OK all hose clamps check OK engine starts and leakages check leakages from oil filter o ring change ok
Customer Remark	ok
Engine Remark	Oil Leakage Issue
Customer Name	purushottam sir
Contact No.	8999491622
Engine Remark	good
Work Remark	

Customer Photo & signature		Service Engineer Photo & signature	

Our Products and Services

<p>KOEL GREEN Renewable Energy Long life for your equipment</p>	<p>KOEL CARE EXTENDED WARRANTY Extended peace of mind For Earthmoving Equipment Engines Only</p>	<p>BA DHAN PEACE OF MIND Unique Service Package</p>	<p>KOEL CARE Genuine Oils and Coolant</p>	<p>Auto Mains Failure Panel for Koel Green Gensets</p>
--	---	--	--	---



Electronic Field Service Report (eFSR)

Customer Name:	Shri Shivaji Education Society		
R. Number:	207922724	Genset Serial Number:	88888888
Work Start Date:	19 Feb 2022 02:10:15 PM	Engine Application Code:	4H.3048...
Work End Date:	19 Feb 2022 03:29:03 PM	Engine Serial Number:	1321520
Total Running Hours:	1790	Product Segment:	MKVA
Type:	KOEL Bandhan	Engine Model:	4R1040
Sub Type:	CM	Dealer Name:	419982_4 Dicksons Engineering Co.Pvt.Ltd. - AMRAVATI
Age:	40	State:	MAHARASHTRA
Plant No.:	3294702	Commissioning Date:	24 Oct 2013
Address:	Dr Pan Jabrao Alias Bhausahab Deshmukh Memorial Medical College, Shivaji Nagar, Amravati, Maharashtra, Amravati, Amravati, M		

D G Set Parameters			
Load_R: 230 Amp	Load_Y: 231 Amp	Load_B: 230 Amp	
Lube Oil Pressure: 4	Lube Oil Temp: °C	Coolant Temp: 72 °C	
Frequency: 415	Frequency: 50	Ambient temp.(Air temp. near Air Cleaner Element):	

Safeties			
Lube Oil Pressure:	WORKING	V Belt Failure (Air cooled):	WORKING
Lube Oil Temp:	WORKING	Coolant Level (Liquid Cooled):	WORKING
Coolant Temp (Liquid Cooled):	WORKING		

DG Check Sheet	
Check Points	Action Taken
Air Intake System	
Air Cleaner (Pre Element) Dry Type:	Found OK
Air Cleaner (Safety Element) Dry Type:	Found OK
Restriction Or Vacuum Indicator Operation:	Found OK
Hose:	Found OK
Hose Clamp:	Found OK
Cleaner Housing Cap:	Found OK
CAC Or Intercooler Fins:	Found OK
Lubrication System	
Lube Oil Level:	Found OK
Lube Oil Leakage:	Found No leakage
Lube Oil Filter:	Found OK
Cooling System	
Coolant Level:	Found OK
Coolant pH Testing:	Found OK(value between 7 to 9)
Coolant Leakage:	Found No leakage
Fan Belt:	Found OK
Radiator Pressure Cap (Rubber gasket and Spring):	Found OK

KOEL
Recovering
life for your equipment

KOEL CARE WARRANTY
Extended peace of mind
For Earthmoving Equipment Engines Only





BA DHAN
Unique Service Package

KOEL CARE Genuine Oils and Coolant

Auto Mains Failure Panel
for Koel Green Gensets



Electronic Field Service Report (eFSR)

Account Details			
Account No.	400874978	Account Name	Shri Shivaji Education Society
Type	Individual Customer	Email	electricpdmc@gmail.com
Contact No.	9922149351	City	Amravati
Pin Code	444603	District	Amravati
Asset Parameters			
Nature Of Failure	fuel leakage		
Problem Summary	ok		
Action Taken	engine oil level check OK v belt check OK all hose check engine starts and leakage check leakage from fuel pipe change		
Engine Remark	ok		
OC	Fuel leakage		
Customer Name	Amit sir		
Contact No.	7709302440		
Customer Remark	good		
Engine Remark			
Customer Photo & signature		Service Engineer Photo & signature	
 Latitude: 21.0270083 Longitude: 77.8404983		 Latitude: 21.0270083 Longitude: 77.8404983	

Our Products and Services



KOEL CARE
Empowering
the life of your equipment



KOEL EXTENDED CARE WARRANTY
Extended peace of mind
For Earthmoving Equipment Engines Only



KOEL BA DHAN
PEACE OF MIND
Unique Service Package



KOEL CARE Genuine Oils and Coolant



KOEL
Auto Mains Failure Panel for Koel Green Generators



Electronic Field Service Report (eFSR)

Customer Name:	Shri Shivaji Education Society		
R. Number:	207974844	Genset Serial Number:	E116004045
Work Start Date:	09 Mar 2022 11:21:48 AM	Engine Application Code:	6H.8404...
Work End Date:	09 Mar 2022 12:52:26 PM	Engine Serial Number:	1620166
Total Running Hours:	213	Product Segment:	MKVA
Type:	KOEL Bandhan	Engine Model:	6K1080TA G2
Sub Type:	BD	Dealer Name:	419982_4 Dicksons Engineering Co.Pvt.Ltd. - AMRAVATI
Capacity:	160	State:	MAHARASHTRA
Machine ID:	100150088	Commissioning Date:	04 Jul 2016
Address:	Dr Pan Jabrao Alias Bhausaheb Deshmukh Memorial Medical College, Shivaji Nagar, Amravati, Maharashtra, Amravati, Amravati, M		

D G Set Parameters

Load_R: 123 Amp	Load_Y: 121 Amp	Load_B: 126 Amp
Lube Oil Pressure: 4.7	Lube Oil Temp: 70 °C	Coolant Temp: 60 °C
Frequency: 50	Ambient temp.(Air temp. near Air Cleaner Element): 60	

Safeties

Lube Oil Pressure:	WORKING	V Belt Failure (Air cooled):	WORKING
Lube Oil Temp:	WORKING	Coolant Level (Liquid Cooled):	WORKING
Coolant Temp (Liquid Cooled):	WORKING		

DG Check Sheet

Check Points	Action Taken
Air Intake System	
Air Cleaner (Pre Element) Dry Type:	Found OK
Air Cleaner (Safety Element) Dry Type:	Found OK
Restriction Or Vacuum Indicator Operation:	Found OK
Hose:	Found OK
Hose Clamp:	Found OK
Air Cleaner Housing Cap:	Found OK
Pre Filter Or Intercooler Fins:	Found OK
Lubrication System	
Lube Oil Level:	Found OK
Oil Leakage:	Found No leakage
Oil Filter:	Found OK
Note: Filter change period is every 500 hrs. or 6 months or every oil change	
Cooling System	
Coolant Level:	Found OK
Coolant pH Testing:	Found OK(value between 7 to 9)
Coolant Leakage:	Found No leakage
Fan Belt:	Found OK
Radiator Pressure Cap (Rubber gasket and Spring):	Found OK

Our Products and Services

<p>KOEL CARE EXTENDED WARRANTY Extended peace of mind For Earthmoving Equipment Engines Only</p>	<p>BA DHAN Unique Service Package</p>	<p>KOEL CARE Genuine Oils and Coolant</p>	<p>Auto Mains Failure Panel for Koel Green Gensets</p>
---	--	--	---



Electronic Field Service Report (eFSR)

Account Details			
Account No.	400874978	Account Name	Shri Shivaji Education Society
Type	Individual Customer	Email	electricpdmc@gmail.com
Contact No.	9922149351	City	Amravati
Pin Code	444603	District	Amravati

Asset Parameters	
Nature Of Failure	d.g. oil.likeg problem
Problem Summary	ok
Action Taken	d.g. oilfilter change & ok
Engine Remark	ok
IC	Oil Leakage Issue
Customer Name	Ashok
Contact No.	9764055598
Service Remark	good
Operation Remark	

Customer Photo & signature	Service Engineer Photo & signature

Our Products and Services

<p>KOEL CARE Repowering Life for your equipment.</p>	<p>KOEL CARE EXTENDED WARRANTY Extended peace of mind For Earthmoving Equipment Engines Only.</p>	<p>BA DHAN PEACE OF MIND Unique Service Package</p>	<p>KOEL CARE Genuine Oils and Coolant</p>	<p>Auto Mains Failure Panel for Koel Green Gensets</p>
---	--	--	--	---



Electronic Field Service Report (eFSR)

Customer Name:	Shri Shivaji Education Society		
R. Number:	207978835		
Work Start Date:	10 Mar 2022 09:24:53 AM	Genset Serial Number:	E116003924
Work End Date:	12 Mar 2022 12:42:00 PM	Engine Application Code:	F6.8736...
Total Running Hours:	258	Engine Serial Number:	1620112
Type:	KOEL Bandhan	Product Segment:	HkVA
Sub Type:	BD	Engine Model:	6SL1500TA G3
Capacity:	250	Dealer Name:	419982_4 Dicksons Engineering Co.Pvt.Ltd. - AMRAVATI
Invoice Number:	100149626	State:	MAHARASHTRA
Home Site ID / SAP ID:		Commissioning Date:	15 Jun 2016
Address:	Dr Pan Jabrao Alias Bhausaheb Deshmukh Memorial Medical College, Shivaji Nagar, Amravati, Maharashtra, Amravati, Amravati, M		

DG Set Parameters		
Load_A: 123 Amp	Load_Y: 123 Amp	Load_B: 122 Amp
Oil Pressure: 4.7	Lube Oil Temp: 70 °C	Coolant Temp: 60 °C
Speed: 415	Frequency: 50	Ambient temp. (Air temp. near Air Cleaner Element): 60

Safeties			
Lube Oil Pressure:	WORKING	V Belt Failure (Air cooled):	WORKING
Lube Oil Temp:	WORKING	Coolant Level (Liquid Cooled):	WORKING
Ambient Temp (Liquid Cooled):	WORKING	Over Speed:	WORKING

DG Check Sheet	
Check Points	Action Taken
Radiator fan alignment w.r.t.shroud:	OK
Fan drive bracket bolt tightness:	OK
Fan Belt Tension:	OK
Fan Belt Condition:	OK
Water Pump Belt Condition:	OK
Water Pump Belt Tension:	OK
Oil leakage from front oil seal:	OK
Oil, Coolant leakage from header assembly:	OK
Fan clutch resistance Or operation:	OK
Fuel leakage:	OK
Condition of Fuel Hoses:	OK
Supporting of fuel hoses, check for fouling, condition of bradding:	OK
Oil leakage at Actuator:	OK
Oil leakage from rocker cover Or cylinder head:	OK
Engine mount bolt tightness:	OK
Alternator bolt tightness:	OK

Our Products and Services

Repowering
Get life for your equipment

KOEL EXTENDED CARE WARRANTY
Extended peace of mind
For Earthmoving Equipment Engines Only





BA DHAN
Unique Service Package

KOEL CARE Genuine Oils and Coolant

Auto Mains Failure Panel for Koel Green Gensets



Electronic Field Service Report (eFSR)

Account Details			
Account No.	400874978	Account Name	Shri Shivaji Education Society
Type	Individual Customer	Email	electricpdmc@gmail.com
Contact No.	9922149351	City	Amravati
Pin Code	444603	District	Amravati
Asset Parameters			
Nature Of Failure	d.g. pm visit		
Problem Summary	ok		
Action Taken	d.g. oil, oilfilter fuel filter change & airfilter change & ok		
Engineer Remark	ok		
Complaint	Oil leakage issue		
Customer Name	Bhele sir		
Contact No.	9158946454		
Customer Remark	good job		
Engineer Remark			
Customer Photo & signature		Service Engineer Photo & signature	
			
Helped the customer to Register on KOEL CONNECT Application		YES	
Customer Name :	Bhele sir	Engineer Name :	KEDARSINGH BINJWAD
Contact No. :	9158946454	Pulse Id :	4199820027

Our Products and Services



KOEL CARE Repowering
Give your equipment a new lease of life for your equipment



KOEL EXTENDED CARE WARRANTY
Extended peace of mind
For Earthmoving Equipment Engines Only



BA DDHAN
Unique Service Package



KOEL CARE Genuine Oils and Coolant



Auto Mains Failure Panel for Koel Green Gensets



Electronic Field Service Report (eFSR)

Customer Name :	Shri Shivaji Education Society		
Number:	207991532	Genset Serial Number:	88888888
Start Date:	14 Mar 2022 02:55:46 PM	Engine Application Code:	4H.3048...
End Date:	14 Mar 2022 04:47:22 PM	Engine Serial Number:	1321520
Running Hours:	1791	Product Segment:	MkVA
Type:	KOEL Bandhan	Engine Model:	4R1040
Sub Type:	CM	Dealer Name:	419982_4 Dicksons Engineering Co.Pvt.Ltd. - AMRAVATI
	40	State:	MAHARASHTRA
Invoice ID:	3294702	Commissioning Date:	24 Oct 2013
Address:	Dr Pan Jabrao Alias Bhausaheb Deshmukh Memorial Medical College, Shivaji Nagar, Amravati, Maharashtra, Amravati, Amravati, M		

D G Set Parameters

R : 13 Amp	Load_Y : 13 Amp	Load_B : 12 Amp
Oil Pressure: 4.7	Lube Oil Temp: 70 °C	Coolant Temp : 60 °C
	Frequency: 50	Ambient temp.(Air temp. near Air Cleaner Element): 60

Safeties

Lube Oil Pressure:	WORKING	V Belt Failure (Air cooled):	WORKING
Lube Oil Temp:	WORKING	Coolant Level (Liquid Cooled):	WORKING
Ambient Temp (Liquid Cooled):	WORKING		

DG Check Sheet

Check Points	Action Taken
Air Intake System	
Air Cleaner (Pre Element) Dry Type:	Found OK
Air Cleaner (Safety Element) Dry Type:	Found OK
Restriction Or Vacuum Indicator Operation:	Found OK
Hose:	Found OK
Hose Clamp:	Found OK
Air Cleaner Housing Cap:	Found OK
CA Or Intercooler Fins:	Found OK
Lubrication System	
Lube Oil Level:	Found OK
Leakage:	Found No leakage
Lube Oil Filter:	Found OK
	Note: Filter change period is every 500 hrs. or 6 months or every oil change
Cooling System	
Coolant Level:	Found OK
Coolant pH Testing:	Found OK(value between 7 to 9)
Coolant Leakage:	Found No leakage
Fan Belt:	Found OK
Radiator Pressure Cap (Rubber gasket and Spring):	Found OK

Our Products and Services





Electronic Field Service Report (eFSR)

Account Details

Account No.	400874978	Account Name	Shri Shivaji Education Society
Customer Name	Individual Customer	Email	electricpdmc@gmail.com
Contact No.	9922149351	City	Amravati
Pin Code	444603	District	Amravati

Asset Parameters

Reason Of Failure	d.g. oil leak problem
Problem Summary	ok
Action Taken	d.g. oilfilter change oil change & ok
Engineer Remark	ok
Customer Remark	Oil Leakage Problem
Engineer Name	Nikhil
Contact No.	8928256468
Customer Remark	good job
Engineer Remark	

Customer Photo & signature

Service Engineer Photo & signature

<p>14.05.22 04:49 PM</p> <p>Latitude: 20.9087387 Longitude: 77.7875904</p>		<p>Latitude: 20.9087387 Longitude: 77.7875904</p>	
--	--	---	--

Our Products and Services

<p>KOEL CARE Recovery Recovery kit for your equipment</p>	<p>KOEL CARE EXTENDED WARRANTY Extended peace of mind For Earthmoving Equipment Engines Only</p>	<p>BA DHAN Unique Service Package</p>	<p>KOEL CARE Genuine Oils and Coolant</p>	<p>Auto Mains Failure Panel for Koel Green Gensets</p>
--	---	--	--	---



Electronic Field Service Report (eFSR)

Customer Name:	Shri Shivaji Education Society		
R. Number:	208015579	Genset Serial Number:	E116004045
ask Start Date:	23 Mar 2022 02:49:32 PM	Engine Application Code:	6H.8404...
ask End Date:	23 Mar 2022 05:22:20 PM	Engine Serial Number:	1620166
total Running Hours:	214	Product Segment:	MkVA
R Type:	KOEL Bandhan	Engine Model:	6K1080TA G2
R Sub Type:	BD	Dealer Name:	419982_4 Dicksons Engineering Co.Pvt.Ltd. - AMRAVATI
VA:	160	State:	MAHARASHTRA
Instance ID:	100150088	Commissioning Date:	04 Jul 2016
Site Address:	Dr Pan Jabrao Alias Bhausaheb Deshmukh Memorial Medical College, Shivaji Nagar, Amravati, Maharashtra, Amravati, Amravati, M		

D G Set Parameters

Load_R: Amp	Load_Y: Amp	Load_B: Amp
Lube Oil Pressure: 4	Lube Oil Temp: °C	Coolant Temp: 76 °C
Oil: 415	Frequency: 50	Ambient temp.(Air temp. near Air Cleaner Element):

Safeties

Low Lube Oil Pressure:	WORKING	V Belt Failure (Air cooled):	WORKING
High Lube Oil Temp:	WORKING	Coolant Level (Liquid Cooled):	WORKING
Coolant Temp (Liquid Cooled):	WORKING		

DG Check Sheet

No.	Check Points	Action Taken
Air Intake System		
1	Air Cleaner (Pre Element) Dry Type:	Found OK
2	Air Cleaner (Safety Element) Dry Type:	Found OK
3	Restriction Or Vacuumindicator Operation:	Found OK
4	Hose:	Found OK
5	Hose Clamp:	Found OK
6	Air Cleaner Housing Cap:	Found OK
7	CAC Or Intercooler Fins:	Found OK
Lubrication System		
8	Lube Oil Level:	Found OK
9	Oil Leakage:	Found No leakage
	Lube Oil Filter:	Found OK Note: Filter change period is every 500 hrs. or 6 months or every oil change
Cooling System		
11	Coolant Level:	Found OK
12	Coolant pH Testing:	Found OK(value between 7 to 9)
13	Coolant Leakage:	Found No leakage
14	Fan Belt:	Found OK
15	Radiator Pressure Cap (Rubber gasket and Spring):	Found OK

Our Products and Services



KOEL EXTENDED CARE WARRANTY
Extended peace of mind
For Earthmoving Equipment Engines Only





Electronic Field Service Report (eFSR)

Account Details

Account No.	400874978	Account Name	Shri Shivaji Education Society
Type	Individual Customer	Email	electricpdmc@gmail.com
Contact No.	9922149351	City	Amravati
Pin Code	444603	District	Amravati

Asset Parameters

Nature Of Failure	fuel leakage
Problem Summary	ok
Action Taken	engine oil level check OK v belt check OK engine starts and leakage check benjo wieshar change ok
Engineer Remark	ok
OC	Diesel Leakage
Customer Name	kapil sir
Contact No.	8605399819
Customer Remark	good
Engineer Remark	

Customer Photo & signature

Service Engineer Photo & signature



Our Products and Services

<p>KOEL CARE Recovering The best of life for your equipment</p>	<p>KOEL CARE EXTENDED WARRANTY Extended peace of mind For Earthmoving Equipment Engines Only</p>	<p>BA DHAN PEACE OF MIND Unique Service Package</p>	<p>KOEL CARE Genuine Oils and Coolant</p>	<p>Auto Mains Failure Panel for Koel Green Gensets</p>
--	---	--	--	---



Electronic Field Service Report (eFSR)

Customer Name:	Shri Shivaji Education Society		
R. Number:	208294899	Genset Serial Number:	E116004045
Ask Start Date:	21 Jun 2022 01:27:10 PM	Engine Application Code:	6H.8404...
Ask End Date:	22 Jun 2022 11:06:32 AM	Engine Serial Number:	1620166
Total Running Hours:	219	Product Segment:	MkVA
R Type:	KOEL Bandhan	Engine Model:	6K1080TA G2
R Sub Type:	BD	Dealer Name:	419982_4 Dicksons Engineering Co.Pvt.Ltd. - AMRAVATI
/A:	160	State:	MAHARASHTRA
Instance ID:	100150088	Commissioning Date:	04 Jul 2016
Site Address:	Dr Pan Jabrao Alias Bhausaheb Deshmukh Memorial Medical College, Shivaji Nagar, Amravati, Maharashtra, Amravati, Amravati, M		

D G Set Parameters

Load_R: 95 Amp	Load_Y: 98 Amp	Load_B: 96 Amp
Lube Oil Pressure: 4.7	Lube Oil Temp: 70 °C	Coolant Temp: 60 °C
Altitude: 415	Frequency: 50	Ambient temp.(Air temp. near Air Cleaner Element): 60

Safeties

Low Lube Oil Pressure:	WORKING	V Belt Failure (Air cooled):	WORKING
High Lube Oil Temp:	WORKING	Coolant Level (Liquid Cooled):	WORKING
Coolant Temp (Liquid Cooled):	WORKING		

DG Check Sheet

No.	Check Points	Action Taken
Air Intake System		
1	Air Cleaner (Pre Element) Dry Type:	Found OK
2	Air Cleaner (Safety Element) Dry Type:	Found OK
3	Restriction Or Vacuum Indicator Operation:	Found OK
4	Hose:	Found OK
5	Hose Clamp:	Found OK
6	Air Cleaner Housing Cap:	Found OK
7	AC Or Intercooler Fins:	Found OK
Lubrication System		
8	Lube Oil Level:	Found OK
9	Oil Leakage:	Found No leakage
10	Lube Oil Filter:	Found OK Note: Filter change period is every 500 hrs. or 6 months or every oil change
Cooling System		
11	Coolant Level:	Found OK
12	Coolant pH Testing:	Found OK(value between 7 to 9)
13	Coolant Leakage:	Found No leakage
14	Fan Belt:	Found OK
15	Radiator Pressure Cap (Rubber gasket and Spring):	Found OK

Our Products and Services

 KOEL CARE Recovering life for your equipment	 KOEL EXTENDED CARE WARRANTY Extended peace of mind For Earthmoving Equipment Engines Only	 BA DHAN Unique Service Package	 KOEL CARE Genuine Oils and Coolant	 Auto Mains Failure Panel for Koel Green Gensets
--	--	--	---	--



Electronic Field Service Report (eFSR)

Account Details			
Int No.	400874978	Account Name	Shri Shivaji Education Society
	Individual Customer	Email	electricpdmc@gmail.com
Act No.	9922149351	City	Amravati
Code	444603	District	Amravati

Asset Parameters	
Type Of Failure	d.g. atuo panel problem
Item Summary	ok
Work Taken	d.g. atuo panel EB mane cable Chenge & ok
Technician Remark	ok
	Automation Issue
Customer Name	bhele sir
Contract No.	9922694924
Customer Remark	good job
Additional Remark	

Customer Photo & signature		Service Engineer Photo & signature	

Our Products and Services

<p>KOEL CARE Repowering Extended life for your equipment</p>	<p>KOEL CARE EXTENDED WARRANTY Extended peace of mind For Earthmoving Equipment Engines Only</p>	<p>BA DHAN Unique Service Package</p>	<p>KOEL CARE Genuine Oils and Coolant</p>	<p>Auto Mains Failure Panel for Koel Green Gensets</p>
---	---	--	--	---



Electronic Field Service Report (eFSR)

Customer Name:	Shri Shivaji Education Society		
Machine Number:	207534982	Genset Serial Number:	E116004045
Work Start Date:	31 Jan 2022 01:22:49 PM	Engine Application Code:	6H.8404...
Work End Date:	31 Jan 2022 03:32:16 PM	Engine Serial Number:	1620166
Total Running Hours:	212	Product Segment:	MKVA
Machine Type:	KOEL Bandhan	Engine Model:	6K1080TA G2
Sub Type:	PM	Dealer Name:	419982_4 Dicksons Engineering Co.Pvt.Ltd. - AMRAVATI
Capacity:	160	State:	MAHARASHTRA
Machine ID:	100150088	Commissioning Date:	04 Jul 2016
Address:	Dr Pan Jabrao Alias Bhausaheb Deshmukh Memorial Medical College, Shivaji Nagar, Amravati, Maharashtra, Amravati, Amravati, M		

D G Set Parameters

Load_A: 230 Amp	Load_Y: 231 Amp	Load_B: 230 Amp
Lube Oil Pressure: 4	Lube Oil Temp: °C	Coolant Temp: 75 °C
Frequency: 415	Frequency: 50	Ambient temp.(Air temp. near Air Cleaner Element):

Safeties

Lube Oil Pressure:	WORKING	V Belt Failure (Air cooled):	WORKING
Lube Oil Temp:	WORKING	Coolant Level (Liquid Cooled):	WORKING
Ambient Temp (Liquid Cooled):	WORKING		

DG Check Sheet

Check Points	Action Taken
Air Intake System	
Air Cleaner (Pre Element) Dry Type:	Found OK
Air Cleaner (Safety Element) Dry Type:	Found OK
Restriction Or Vacuum Indicator Operation:	Found OK
Hose:	Found OK
Hose Clamp:	Found OK
Air Cleaner Housing Cap:	Found OK
CAC Or Intercooler Fins:	Found OK
Lubrication System	
Oil Level:	Found OK
Oil Leakage:	Found No leakage
Lube Oil Filter:	Found OK
	Note: Filter change period is every 500 hrs. or 6 months or every oil change
Cooling System	
Coolant Level:	Found OK
Coolant pH Testing:	Found OK(value between 7 to 9)
Coolant Leakage:	Found No leakage
Fan Belt:	Found OK
Radiator Pressure Cap (Rubber gasket and Spring):	Found OK

Our Products and Services





<p>KOEL CARE EXTENDED WARRANTY Extended peace of mind For Earthmoving Equipment Engines Only</p>	<p>BA DHAN PEACE OF MIND Unique Service Package</p>	<p>KOEL CARE Genuine Oils and Coolant</p>	<p>Auto Mains Failure Panel for Koel Green Gensets</p>
---	--	--	---

**koskar
care**



Electronic Field Service Report (eFSR)



Account Details			
Account No.	400874978	Account Name	Shri Shivaji Education Society
	Individual Customer	Email	electricpdmc@gmail.com
Contact No.	9922149351	City	Amravati
Code	444603	District	Amravati
Asset Parameters			
Reason Of Failure	AMC visit		
Problem Summary	ok		
Work Done	engine oil level check OK v belt check OK all hose clamps check OK battery level check OK coolant level check OK		
Inspection Remark	ok		
Customer Name	bele sir		
Contact No.	9922694824		
Inspection Remark	good		
Option Remark			
Customer Photo & signature		Service Engineer Photo & signature	
			

Our Products and Services



KOEL CARE Repowering
Extend the life for your equipment



KOEL EXTENDED WARRANTY
Extended peace of mind
For Earthmoving Equipment
Engines Only



BA DHAN
Unique Service Package



KOEL CARE Genuine Oils and Coolant



Auto Mains Failure Panel for Koel Green Gensets



Electronic Field Service Report (eFSR)

Customer Name :	Shri Shivaji Education Society		
Machine Number:	207534983	Genset Serial Number:	E116004045
Start Date:	14 May 2022 03:31:48 PM	Engine Application Code:	6H.8404...
End Date:	14 May 2022 04:26:52 PM	Engine Serial Number:	1620166
Running Hours:	218	Product Segment:	MkVA
Type:	KOEL Bandhan	Engine Model:	6K1080TA G2
Sub Type:	PM	Dealer Name:	419982_4 Dicksons Engineering Co.Pvt.Ltd. - AMRAVATI
	160	State:	MAHARASHTRA
Machine ID:	100150088	Commissioning Date:	04 Jul 2016
Address:	Dr Pan Jabrao Alias Bhausahab Deshmukh Memorial Medical College, Shivaji Nagar, Amravati, Maharashtra, Amravati, Amravati, M		

D G Set Parameters

Rated Amp	Load_Y : Amp	Load_B : Amp
Rated Pressure: 06	Lube Oil Temp: 79 °C	Coolant Temp : 62 °C
Rated Voltage: 415	Frequency: 50	Ambient temp.(Air temp. near Air Cleaner Element): 60

Safeties

Lube Oil Pressure:	WORKING	V Belt Failure (Air cooled):	WORKING
Lube Oil Temp:	WORKING	Coolant Level (Liquid Cooled):	WORKING
Ambient Temp (Liquid Cooled):	WORKING		

DG Check Sheet





Check Points	Action Taken
Air Intake System	
Air Cleaner (Pre Element) Dry Type:	Found OK
Air Cleaner (Safety Element) Dry Type:	Found OK
Restriction Or Vacuum Indicator Operation:	Found OK
Hose:	Found OK
Hose Clamp:	Found OK
Air Cleaner Housing Cap:	Found OK
CAC Or Intercooler Fins:	Found OK
Lubrication System	
Lube Oil Level:	Found OK
Lube Oil Leakage:	Found No leakage
Lube Oil Filter:	Found OK
	Note: Filter change period is every 500 hrs. or 6 months or every oil change
Cooling System	
Coolant Level:	Found OK
Coolant pH Testing:	Found OK(value between 7 to 9)
Coolant Leakage:	Found No leakage
Fan Belt:	Found OK
Radiator Pressure Cap (Rubber gasket and Spring):	Found OK

Our Products and Services

 KOEL CARE EXTENDED WARRANTY Extended peace of mind For Earthmoving Equipment Engines Only	 BA DHAN Unique Service Package	 KOEL CARE Genuine Oils and Coolant	 Auto Mains Failure Panel for Koel Green Gensets
---	--	--	---



Electronic Field Service Report (eFSR)

Account Details			
Unit No.	400874978	Account Name	Shri Shivaji Education Society
	Individual Customer	Email	electricpdmc@gmail.com
Contract No.	9922149351	City	Amravati
Code	444603	District	Amravati
Asset Parameters			
Reason Of Failure	AMC VISIT		
Item Summary	ok		
Work Done	engine oil, coolant, vbelt, battery check found ok		
Technician Remark	ok		
Customer Name	Suyog sir		
Contact No.	9049610568		
Customer Remark	good		
Additional Remark			
Customer Photo & signature		Service Engineer Photo & signature	
			

Our Products and Services



REPOWERING
Give new life to your equipment



KOEL CARE EXTENDED WARRANTY
Extended peace of mind
For Earthmoving Equipment Engines Only



BA DHAN
PEACE OF MIND
Unique Service Package



KOEL CARE Genuine Oils and Coolant



Auto Mains Failure Panel
for Koel Green Gensets

Dr. Panjabrao alias Bhausaheb Deshmukh
 Memorial Medical College
 Shivaji Nagar, Amravati - 444 603
 Phone : 0721- 2552353 / 2662323/2665545/ Fax : 0721 - 2552353

Jan - 2023

Electrical Department
Daily maintenance checks List.

Name of Place:- **WARD NO. 9 & 10**

Date	Fan	Tubelig ht	Switch/ Plug	MCB	Wires	Remarks	Signature of incharge	Signature of Employee
01/01/23	—				—	—		
02/01/23	✓	✓	✓	✓	✓		Badhawade	
03/01/23	✓	✓	✓	✓	✓		Badhawade	
04/01/23	✓	✓	✓	✓	✓		Badhawade	
05/01/23	✓	✓	✓	✓	✓		Badhawade	
06/01/23	✓	✓	✓	✓	✓		Badhawade	
07/01/23	✓	✓	✓	✓	✓		Badhawade	
08/01/23	—				—	—	Badhawade	
09/01/23	✓	✓	✓	✓	✓		Badhawade	
10/01/23	✓	✓	✓	✓	✓		Badhawade	
11/01/23	✓	✓	✓	✓	✓		Badhawade	
12/01/23	✓	✓	✓	✓	✓		Badhawade	
13/01/23	✓	✓	✓	✓	✓		Badhawade	
14/01/23	✓	✓	✓	✓	✓		Badhawade	
15/01/23	—				—	—	Badhawade	
16/01/23	✓	✓	✓	✓	✓		Badhawade	
17/01/23	✓	✓	✓	✓	✓		Badhawade	
18/01/23	✓	✓	✓	✓	✓		Badhawade	

19/01/23	✓	✓	✓	✓	✓				Wahuss	Off.
20/01/23	✓	✓	✓	✓	✓				in Ealhand	Off.
21/01/23	✓	✓	✓	✓	✓				Bathwick	Off.
22/01/23	—				—	—	—			
23/01/23	✓	✓	✓	✓	✓				Ealhand	Off.
24/01/23	✓	✓	✓	✓	✓	—	—		Stretton	Off.
25/01/23	✓	✓	✓	✓	✓				Bathwick	Off.
26/01/23	—				—	—	—			
27/01/23	✓	✓	✓	✓	✓				Stretton	Off.
28/01/23	✓	✓	✓	✓	✓	—	—		Stretton	Off.
29/01/23	—				—	—	—			
30/01/23	✓	✓	✓	✓	✓				Bathwick	Off.
31/01/23	✓	✓	✓	✓	✓				Bathwick	Off.

Dr. Panjabrao alias Bhausaheb Deshmukh
 Memorial Medical College
 Shivaji Nagar, Amravati - 444 603
 Phone : 0721- 2552353 / 2662323/2665545/ Fax : 0721 - 2552353

Electrical Department
Daily maintenance checks List.

Name of Place:- **WARD NO. 11**

Date	Fan	Tubelig ht	Switch/ Plug	MCB	Wires	Remarks	Signature of inchrage	Signature of Employee
01/01/23	—				—	—	—	—
02/01/23	✓	✓	✓	✓	✓		<i>Medical Incharge</i>	<i>[Signature]</i>
03/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
04/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
05/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
06/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
07/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
08/01/23	—				—	—	—	—
09/01/23	①	①	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
10/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
11/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
12/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
13/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
14/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
15/01/23	—				—	—	—	—
16/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
17/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
18/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>

Dr. Panjabrao alias Bhausaheb Deshmukh
Memorial Medical College

Shivaji Nagar, Amravati - 444 603

Phone : 0721- 2552353 / 2662323/2665545/ Fax : 0721 - 2552353

Electrical Department

Daily maintenance checks List.

Name of Place:- WARD NO. 12 & 13

Date	Fan	Tubelight	Switch/ Plug	MCB	Wires	Remarks	Signature of incharge	Signature of Employee
01/01/23	—	—	—	—	—	—	—	—
02/01/23	✓	✓	✓	✓	✓		Shenoh	Off.
03/01/23	✓	✓	✓	✓	✓		Shenoh	Off.
04/01/23	✓	✓	✓	✓	✓		Shenoh	Off.
05/01/23	✓	✓	✓	✓	✓		Shenoh	Off.
06/01/23	✓	✓	✓	✓	✓		Shenoh	Off.
07/01/23	✓	✓	✓	✓	✓		Shenoh	Off.
08/01/23	—	—	—	—	—	—	—	—
09/01/23	✓	✓	✓	✓	✓		Shenoh	Off.
10/01/23	✓	✓	✓	✓	✓		Shenoh	Off.
11/01/23	✓	✓	✓	✓	✓		Shenoh	Off.
12/01/23	✓	✓	✓	✓	✓		Shenoh	Off.
13/01/23	✓	✓	✓	✓	✓		Shenoh	Off.
14/01/23	✓	✓	✓	✓	✓		Shenoh	Off.
15/01/23	—	—	—	—	—	—	—	—
16/01/23	✓	✓	✓	✓	✓		Shenoh	Off.
17/01/23	✓	✓	✓	✓	✓		Shenoh	Off.
18/01/23	✓	✓	✓	✓	✓	Excut chemo	Shenoh	Off.

Dr. Panjabrao alias Bhausaheb Deshmukh
 Memorial Medical College
 Shivaji Nagar, Amravati - 444 603
 Phone : 0721- 2552353 / 2662323/2665545/ Fax : 0721 - 2552353

Electrical Department
Daily maintenance checks List.

Name of Place:- **WARD NO. 14 & 15**

Date	Fan	Tubelig ht	Switch/ Plug	MCB	Wires	Remarks	Signature of incharge	Signature of Employee
01/01/23	—	—	—	—	—	—	—	—
02/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
03/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
04/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
05/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
06/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
07/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
08/01/23	—	—	—	—	—	—	—	—
09/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
10/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
11/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
12/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
13/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
14/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
15/01/23	—	—	—	—	—	—	—	—
16/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
17/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>
18/01/23	✓	✓	✓	✓	✓		<i>[Signature]</i>	<i>[Signature]</i>

19/01/23	✓	✓	✓	✓	✓		Stace	OK
20/01/23	✓	✓	✓	✓	✓		Stace	OK
21/01/23	✓	✓	✓	✓	✓		Drum	OK
22/01/23	—	—	—	—	—	—	—	—
23/01/23	✓	✓	✓	✓	✓		No print	OK
24/01/23	✓	✓	✓	✓	✓		Drum	OK
25/01/23	✓	✓	✓	✓	✓		Drum	OK
26/01/23	—	—	—	—	—	—	—	—
27/01/23	✓	✓	✓	✓	✓		Revised	OK
28/01/23	✓	✓	✓	✓	✓		Drum	OK
29/01/23	—	—	—	—	—	—	—	—
30/01/23	✓	✓	✓	✓	✓		No print	OK
31/01/23	✓	✓	✓	✓	✓		Drum	OK

Dr. Panjabrao alias Bhausaheb Deshmukh
Memorial Medical College
Shivaji Nagar, Amravati - 444 603
Phone : 0721- 2552353 / 2662323/2665545/ Fax : 0721 - 2552353

Electrical Department
Daily maintenance checks List.

Name of Place:- *आयुर्वेदिक आय. सि. यु.*

Month :- Jan. 2023

Date	Fan	Tubelig ht	Switch/ Plug	MCB	Wires	Remarks	Signature of incharge	Signature of Employee
1/1/23	-	-	-	-	-	Sunday	-	-
2/1/23	✓	✓	✓	✓	✓		<i>J. Deshmukh</i>	<i>Bhadse.</i>
3/1/23	✓	✓	✓	✓	✓		<i>Madhuri Deshmukh</i>	<i>Bhadse.</i>
4/1/23	✓	✓	✓	✓	✓		<i>Deshmukh</i>	<i>R. Kala</i>
5/1/23	✓	✓	✓	✓	✓		<i>Deshmukh</i>	<i>R. Kala</i>
6/1/23	✓	✓	✓	✓	✓		<i>J. Deshmukh</i>	<i>Bhadse.</i>
7/1/23	✓	✓	✓	✓	✓		<i>J. Deshmukh</i>	<i>Bhadse.</i>
8/1/23	-	-	-	-	-	Sunday	-	-
9/1/23	✓	✓	✓	✓	✓		<i>J. Deshmukh</i>	<i>Bhadse.</i>
10/1/23	✓	✓	✓	✓	✓		<i>J. Deshmukh</i>	<i>Bhadse.</i>
11/1/23	✓	✓	✓	✓	✓		<i>J. Deshmukh</i>	<i>Bhadse.</i>
12/1/23	✓	✓	✓	✓	✓		<i>J. Deshmukh</i>	<i>Bhadse.</i>
13/1/23	✓	✓	✓	✓	✓		<i>J. Deshmukh</i>	<i>Bhadse.</i>
14/1/23	✓	✓	✓	✓	✓		<i>J. Deshmukh</i>	<i>Bhadse.</i>
15/1/23							<i>J. Deshmukh</i>	<i>Bhadse.</i>
16/1/23						<i>@vimalj</i>		
17/1/23						<i>—</i>		
18/1/23						<i>—</i>		
						<i>—</i>		

19/1/23	✓	✓	✓	✓	✓	✓	—		
20/1/23	✓	✓	✓	✓	✓	✓			Rehuse.
21/1/23	✓	✓	✓	✓	✓	✓		Topple	Rehuse.
22/1/23	—	—	—	—	—	—	Sunday	Menda SIM	Rehuse.
23/1/23	✓	✓	✓	✓	✓	✓		Halika SIM	Rehuse.
24/1/23	✓	✓	✓	✓	✓	✓		A.R. WesN	Rehuse.
25/1/23	✓	✓	✓	✓	✓	✓		Ekya SIM	Rehuse.
26/1/23	—	—	—	—	—	—	Holiday	—	—
27/1/23	✓	✓	✓	✓	✓	✓		Halika SIM	Rehuse.
28/1/23	✓	✓	✓	✓	✓	✓			Rehuse.

Dr. Panjabrao alias Bhausaheb Deshmukh
 Memorial Medical College
 Shivaji Nagar, Amravati - 444 603
 Phone : 0721- 2552353 / 2662323/2665545/ Fax : 0721 - 2552353

Electrical Department
Daily maintenance checks List.

Name of Place:- *cardiac icu.*

Date	Fan	Tubelight	Switch/Plug	MCB	Wires	Remarks	Signature of incharge	Signature of Employee
1/1/23	✓	—	—	—	—	sunday	—	—
2/1/23	✓	✓	✓	✓	✓		<i>vishwas</i>	<i>Rohadse.</i>
3/1/23	✓	✓	✓	✓	✓	Blub Led at 02.51	<i>pry</i>	<i>Rohadse.</i>
4/1/23	✓	✓	✓	✓	✓	—cc—	<i>pry</i>	<i>RKula</i>
5/1/23	✓	✓	✓	✓	✓	—cc—	<i>pry</i>	<i>RKula</i>
6/1/23	✓	034	✓	✓	✓		<i>pry</i>	<i>Rohadse.</i>
7/1/23	✓	✓	✓	✓	✓			<i>Rohadse.</i>
8/1/23	—	—	—	—	—	sunday		<i>Rohadse.</i>
9/1/23	✓	✓	✓	✓	✓		<i>pry</i>	<i>Rohadse.</i>
10/1/23	✓	✓	✓	✓	✓		<i>pry</i>	<i>Rohadse.</i>
11/1/23	✓	✓	✓	✓	✓			<i>Rohadse.</i>
12/1/23	✓	✓	✓	✓	✓			<i>Rohadse.</i>
13/1/23	✓	✓	✓	✓	✓		<i>pry</i>	<i>Rohadse.</i>
14/1/23	✓	✓	✓	✓	✓			<i>Rohadse.</i>

Dr. Panjabrao alias Bhausaheb Deshmukh
 Memorial Medical College
 Shivaji Nagar, Amravati - 444 603
 Phone : 0721- 2552353 / 2662323/2665545/ Fax : 0721 - 2552353

Electrical Department
Daily maintenance checks List.

Name of Place:- ward 7,8

Date	Fan	Tubelig ht	Switch/ Plug	MCB	Wires	Remarks	Signature of incharge	Signature of Employee
1/2/23	✓	✓	✓	✓	✓			
2/2/23	✓	✓	✓	✓	✓			
3/2/23	✓	✓	✓	✓	✓			
4/2/23	✓	✓	✓	✓	✓			
5/2/23	✓	✓	✓	✓	✓	कागज का बदलना	(seema)	
6/2/23	✓	✓	✓	✓	✓	बिजली		
7/2/23	✓	✓	✓	✓	✓			
8/2/23	✓	✓	✓	✓	✓			
9/2/23	✓	✓	✓	✓	✓			
10/2/23	✓	✓	✓	✓	✓			
11/2/23	✓	✓	✓	✓	✓			
12/2/23	✓	✓	✓	✓	✓			
13/2/23	✓	✓	✓	✓	✓			
14/2/23	✓	✓	✓	✓	✓	बिजली का काम		
15/2/23	✓	✓	✓	✓	✓	बिजली		
16/2/23	✓	✓	✓	✓	✓			
17/2/23	✓	✓	✓	✓	✓			
18/2/23	✓	✓	✓	✓	✓			

Dr. Panjabrao alias Bhausaheb Deshmukh
Memorial Medical College
Shivaji Nagar, Amravati - 444 603

Phone : 0721- 2552353 / 2662323/2665545/ Fax: 0721 - 2552353

Feb - 023

Electrical Department
Daily maintenance checks List.

Name of Place:- गायनिक ICU.

Date	Fan	Tubelight	Switch/ Plug	MCB	Wires	Remarks	Signature of incharge	Signature of Employee
1/2/23	✓	✓	✓	✓	✓		Hellkar SH	Bhadse.
2/2/23	✓	✓	✓	✓	✓		Hellkar SH	Bhadse.
3/2/23	✓	✓	✓	✓	✓		Hellkar SH	Bhadse.
4/2/23	✓	✓	✓	✓	✓		Hellkar SH	Bhadse.
5/2/23	—	—	—	—	—	sunday	—	—
6/2/23	✓	✓	✓	✓	✓		Hellkar SH	Bhadse.
7/2/23	—	—	—	—	—	TH	—	—
8/2/23	✓	✓	✓	✓	✓		A.R. Desai	Bhadse.
9/2/23	✓	✓	✓	✓	✓		A.R. Desai	Bhadse.
10/2/23	✓	✓	✓	✓	✓		Shylpawar SW.	Bhadse.
11/2/23	✓	✓	✓	✓	✓		Shylpawar SW.	Bhadse.
12/2/23	—	—	—	—	—	sunday	—	—
13/2/23	✓	✓	✓	✓	✓		Shylpawar SW.	Bhadse.
14/2/23	✓	✓	✓	✓	✓	1 fan circ 3rd	Hellkar SH	Bhadse.
15/2/23	✓	✓	✓	✓	✓	Telephone Loose connection	Hellkar SH	Bhadse.
16/2/23	—	—	—	—	—		—	Bhadse.
17/2/23	✓	✓	✓	✓	✓		—	—

I/C Repair Section

Chairperson - Criteria No. NAAC Steering Committee
Dr P D M. M. C. Amravati

DEAN